


Customer :

Peerless Pump Company
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

| | | | |
|-------------------------------|---------------------|--------------------------------------|--------------|
| Project : | | Contact : | |
| Quote No. : US-2222-17 | Page No. : 1 | Phone : | Fax : |
| | | Date : Monday, April 14, 2003 | |

| | | |
|--|---|---------------------------------------|
| Pump Model: Peerless - 6x8-13 XLTP 8196 | Nom. Speed: 1150 RPM, 60 Hz Electric | Duty Flow : US gpm |
| Type: 8196 - ANSI Standard End Suction | Impeller Dia.: 13/10 inch | Duty Head : ft |
| | Temperature: 68 °F | Efficiency : % |
| | Viscosity: 1.009 cP | Power Required : hp |
| Curve No.: 8196-044 | Sp. Gravity: 1.000 | NPSH Required : ft |
| Impeller No. | Fluid: Water | Peak Power: 28.95 hp |
| Item : 1 | | Closed Valve Pressure 84.64 ft |
| Your Ref.: | Tolerance : Hyd Inst-Peerless Std | |

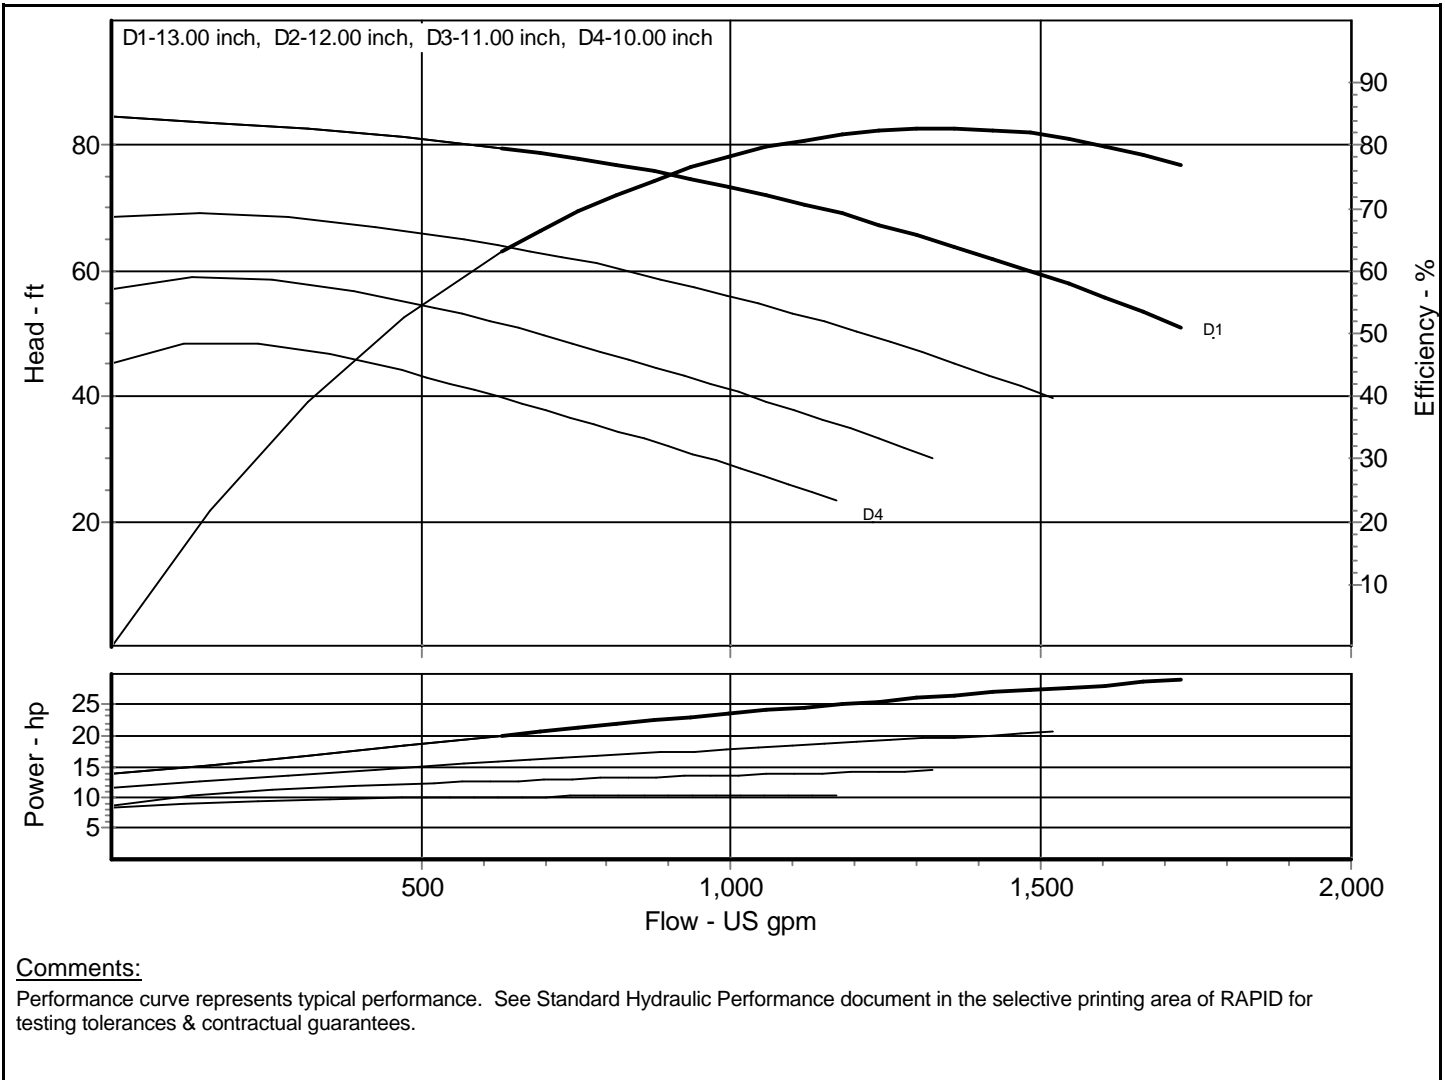

Customer :

Peerless Pump Company
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

| | | | |
|--|---|--------------------------------------|--------------|
| Project : | | Contact : | |
| Quote No. : US-2222-17 | Page No. : 1 | Phone : | Fax : |
| | | Date : Monday, April 14, 2003 | |
| Pump Model: Peerless - 6x8-13 XLTP 8196 | Nom. Speed: 1750 RPM, 60 Hz Electric | Duty Flow : | US gpm |
| Type: 8196 - ANSI Standard End Suction | Impeller Dia.: 13/10 inch | Duty Head : | ft |
| | Temperature: 68 °F | Efficiency : | % |
| | Viscosity: 1.009 cP | Power Required : | hp |
| Curve No.: 8196-043 | Sp. Gravity: 1.000 | NPSH Required : | ft |
| Impeller No.: | Fluid: Water | Peak Power: | 101.31 hp |
| Item : 1 | | Closed Valve Pressure | 196 ft |
| Your Ref.: | Tolerance : Hyd Inst-Peerless Std | | |

