


Customer :

Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana


|  |   |                                      |              |
|--|---|--------------------------------------|--------------|
| <b>Project :</b>                                 |   | <b>Contact :</b>                     |              |
| <b>Quote No. :</b> US-2222-17                    | <b>Page No. :</b> 1                         | <b>Phone :</b>                       | <b>Fax :</b> |
|  |   | <b>Date :</b> Monday, April 14, 2003 |              |
| <b>Pump Model:</b> Peerless - 1x1.5-8 STP 8196LF | <b>Nom. Speed:</b> 1750 RPM, 60 Hz Electric | <b>Duty Flow :</b>                   | US gpm       |
| <b>Type:</b> 8196 - ANSI Standard End Suction    | <b>Impeller Dia.:</b> 8/6 inch              | <b>Duty Head :</b>                   | ft           |
|  | <b>Temperature:</b> 68 °F                   | <b>Efficiency :</b>                  | %            |
|  | <b>Viscosity:</b> 1.009 cP                  | <b>Power Required :</b>              | hp           |
| <b>Curve No.:</b> 8196LF-004                     | <b>Sp. Gravity:</b> 1.000                   | <b>NPSH Required :</b>               | ft           |
| <b>Impeller No.:</b>                             | <b>Fluid:</b> Water                         | <b>Peak Power:</b>                   | 1.56 hp      |
| <b>Item :</b> 1                                  |   | <b>Closed Valve Pressure</b>         | 63.018 ft    |
| <b>Your Ref.:</b>                                | <b>Tolerance :</b> Hyd Inst-Peerless Std    |                                      |              |

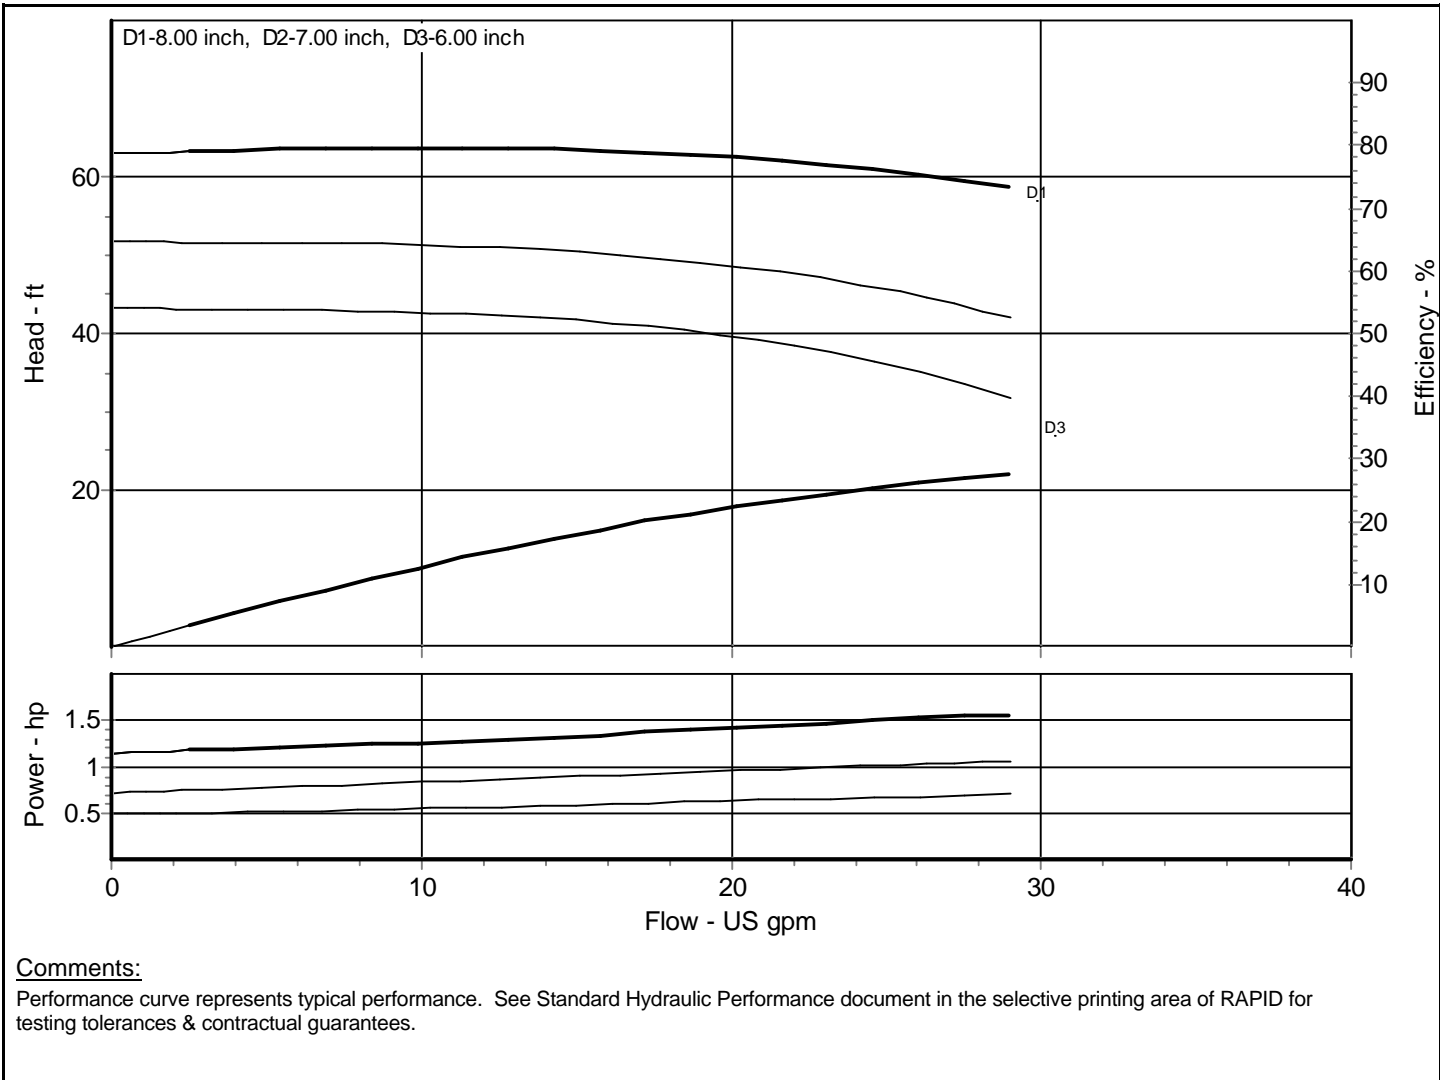

Customer :

Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

|  |   |                                      |              |
|--|---|--------------------------------------|--------------|
| <b>Project :</b>                                 |   | <b>Contact :</b>                     |              |
| <b>Quote No. :</b> US-2222-17                    | <b>Page No. :</b> 1                         | <b>Phone :</b>                       | <b>Fax :</b> |
|  |   | <b>Date :</b> Monday, April 14, 2003 |              |
| <b>Pump Model:</b> Peerless - 1x1.5-8 STP 8196LF | <b>Nom. Speed:</b> 3550 RPM, 60 Hz Electric | <b>Duty Flow :</b>                   | US gpm       |
| <b>Type:</b> 8196 - ANSI Standard End Suction    | <b>Impeller Dia.:</b> 8/6 inch              | <b>Duty Head :</b>                   | ft           |
|  | <b>Temperature:</b> 68 °F                   | <b>Efficiency :</b>                  | %            |
|  | <b>Viscosity:</b> 1.009 cP                  | <b>Power Required :</b>              | hp           |
| <b>Curve No.:</b> 8196LF-003                     | <b>Sp. Gravity:</b> 1.000                   | <b>NPSH Required :</b>               | ft           |
| <b>Impeller No.:</b>                             | <b>Fluid:</b> Water                         | <b>Peak Power:</b>                   | 11.12 hp     |
| <b>Item :</b> 1                                  |   | <b>Closed Valve Pressure</b>         | 257.983 ft   |
| <b>Your Ref.:</b>                                | <b>Tolerance :</b> Hyd Inst-Peerless Std    |                                      |              |

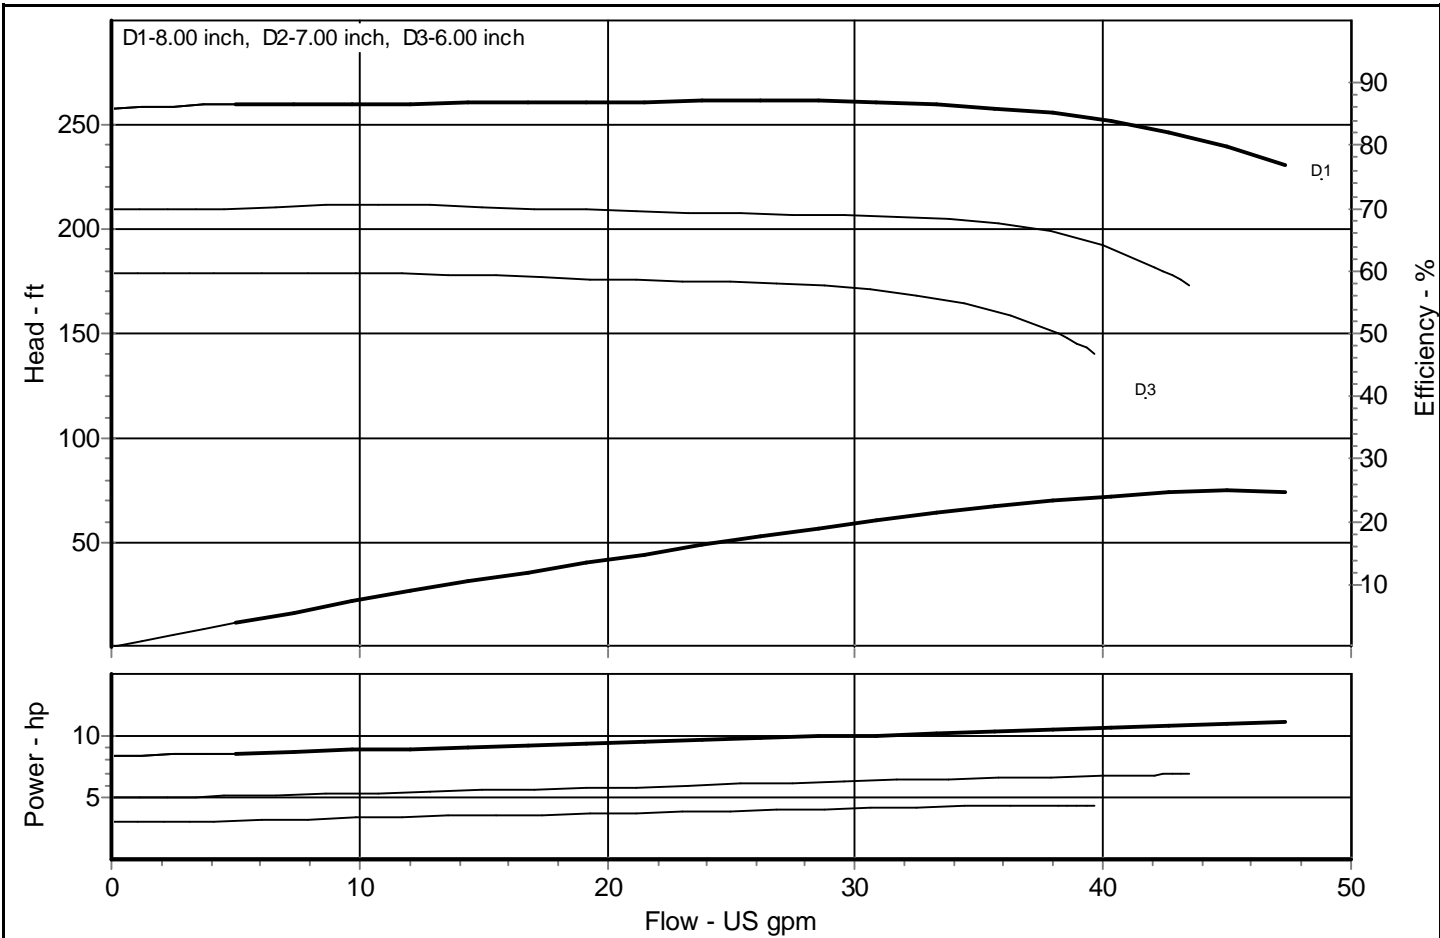

**Comments:**

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

