



Peerless Pump Company  
Indianapolis, IN 46207-7025


VERTICAL TURBINE PUMPS  
Model 8HXB - 3460 Rpm

SECTION 140  
Page 3460-17  
September, 1985

### 2 POLE 60 HERTZ PERFORMANCE

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 4
2	Lower 3
3	Lower 2
4	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

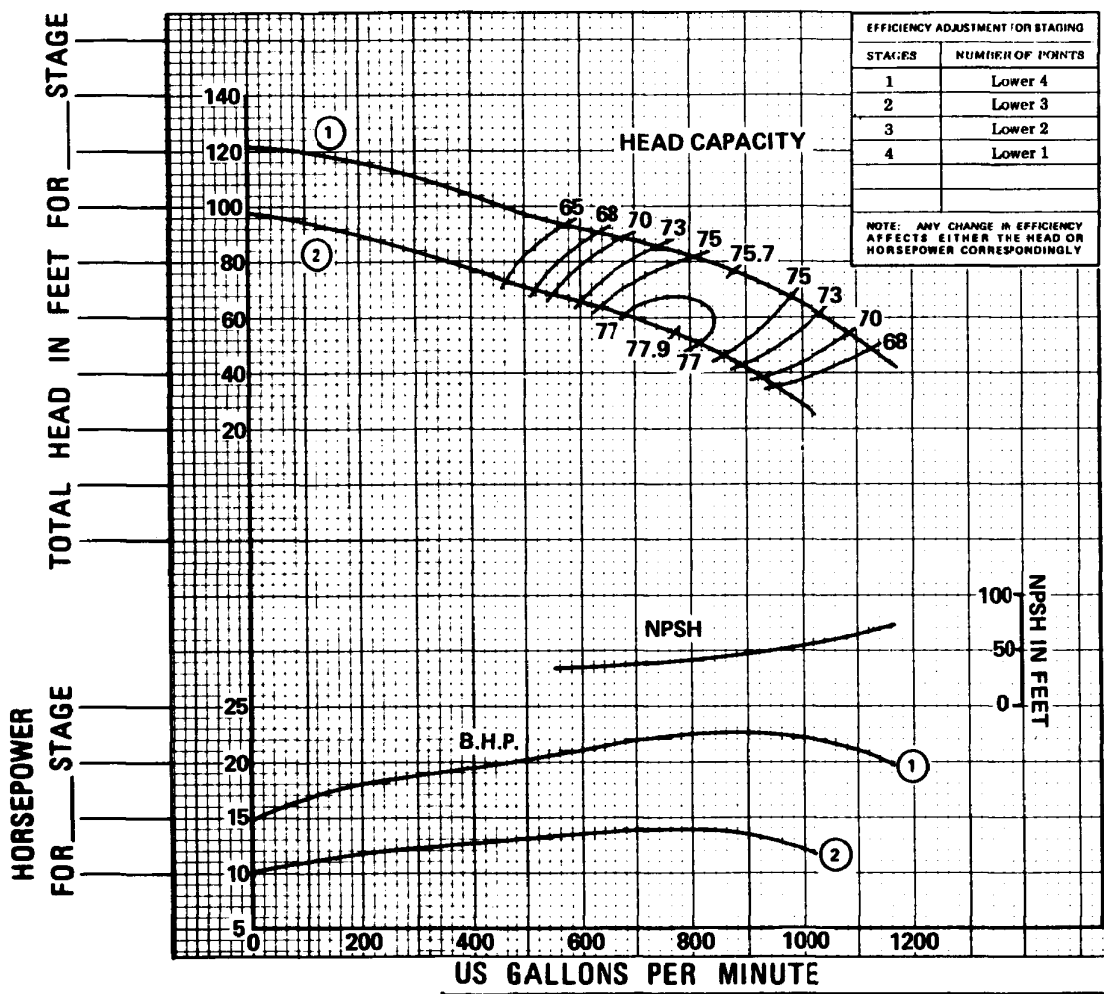

Capacity \_\_\_\_\_ gpm  
 Head \_\_\_\_\_ Feet  
 BHP \_\_\_\_\_  
 EFFICIENCY \_\_\_\_\_ %

DRIVER \_\_\_\_\_  
 HEAD \_\_\_\_\_  
 COLUMN \_\_\_\_\_

CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
1	2616348	5-3/16" x 6"	55684
2	2616348	4-13/16" x 5-5/8"	55745
3			
4			


Customer _____		
Item _____		
Peerless Ref. No: _____		
<b>Laboratory Performance</b>		BOWL 2616346 CIE
SIZE 8HXB	RPM 3460	CURVE 4806272



Peerless Pump Company  
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS  
Model 8HXB-1760 Rpm

SECTION 140  
Page 1760-17  
May, 1985

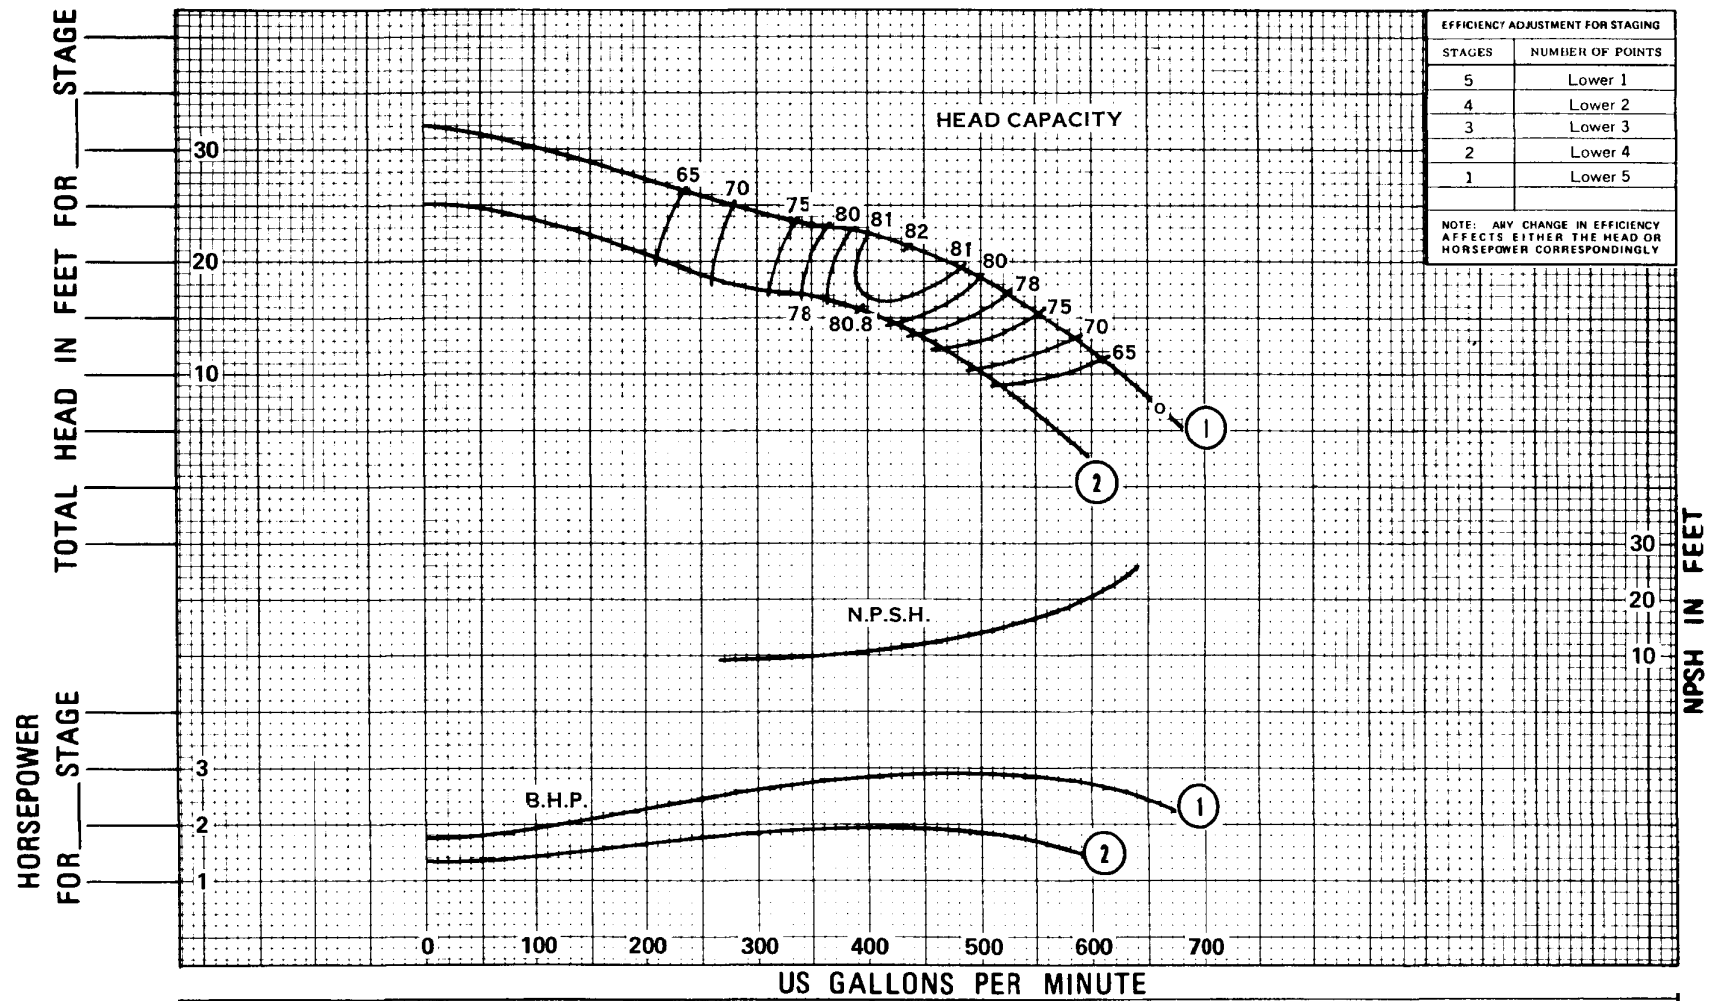

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
5	Lower 1
4	Lower 2
3	Lower 3
2	Lower 4
1	Lower 5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	2616348	5-3/16" x 6"	58210	Item _____
	2	2616348	4-13/16" x 5-5/8"	58259	Peerless Ref. No: _____
	3				
	4				


Laboratory Performance		
SIZE	8HXB	RPM 1760
BOWL	2616346	C.I.E.
CURVE	4806227	

PUMP DESCRIPTION: Driver \_\_\_\_\_; Head \_\_\_\_\_; Column \_\_\_\_\_  
 GUARANTEED BOWL  PERFORMANCE: Capacity \_\_\_\_\_ gpm; Head \_\_\_\_\_ ft; Eff \_\_\_\_\_ %; BHP \_\_\_\_\_  
 FIELD

VERTICAL TURBINE PUMPS



Peerless Pump Company  
Indianapolis, IN 46207-7025

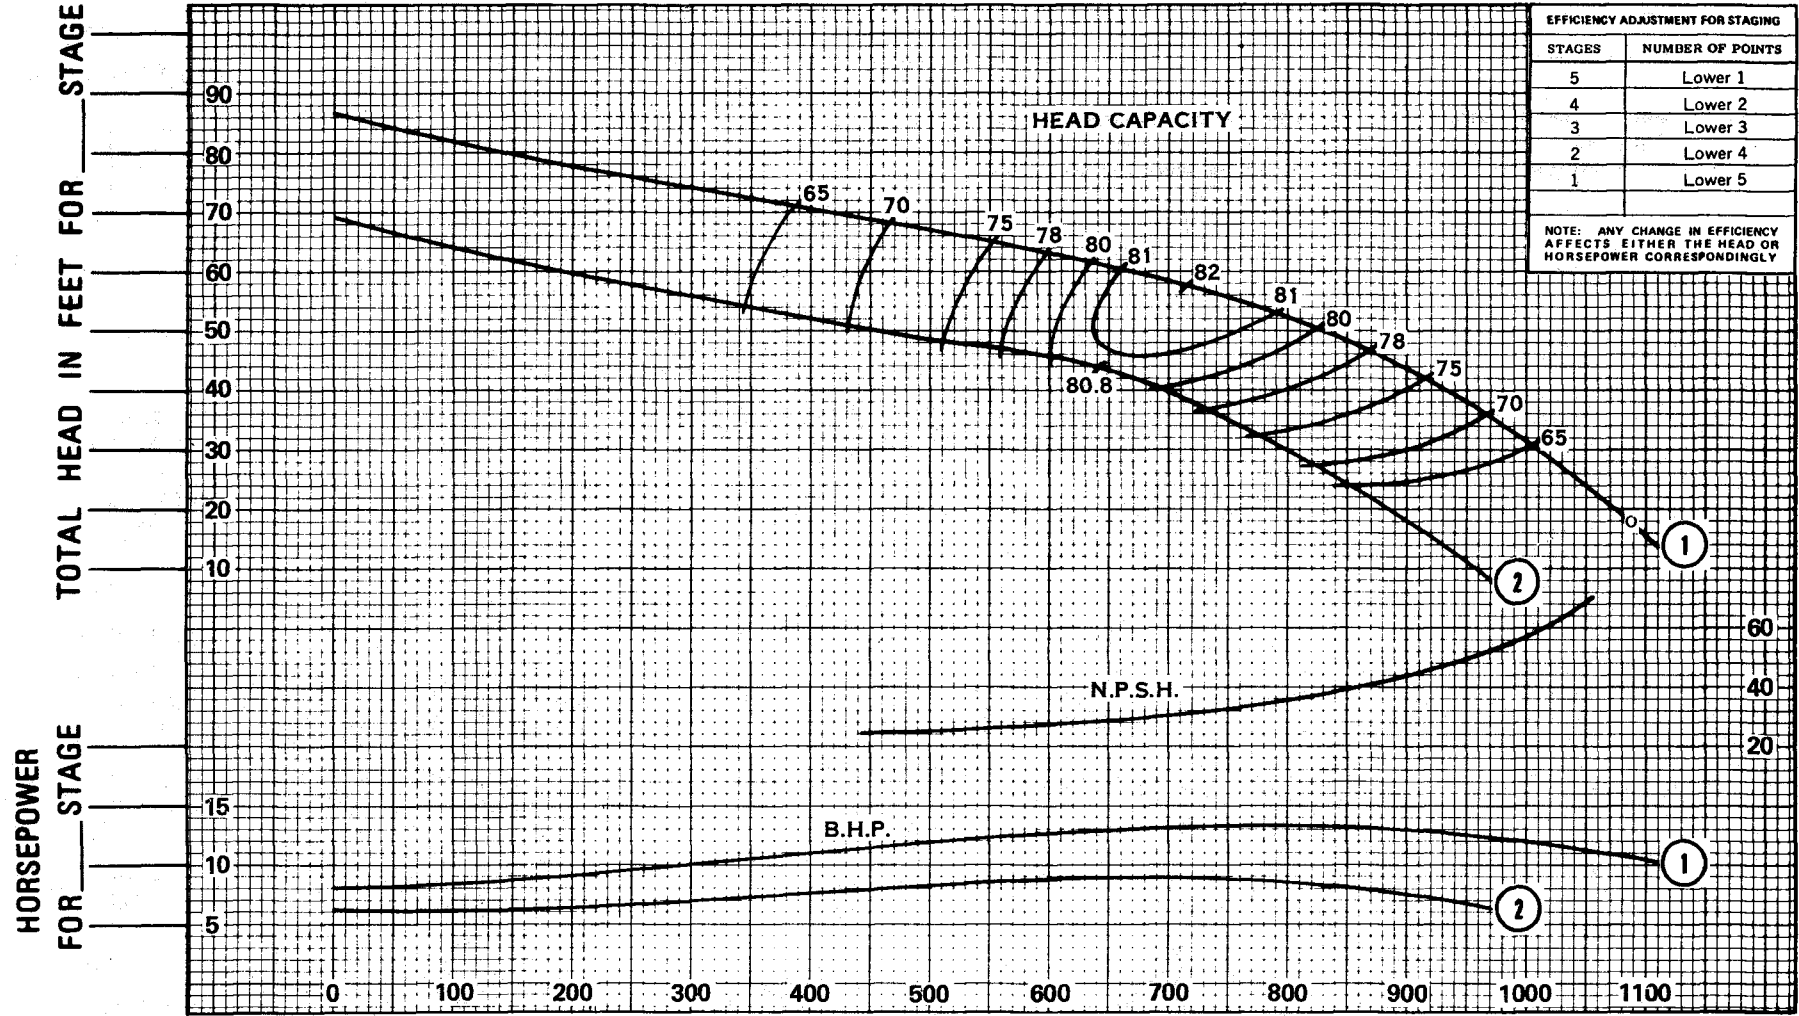

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
5	Lower 1
4	Lower 2
3	Lower 3
2	Lower 4
1	Lower 5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HORSEPOWER FOR STAGE

TOTAL HEAD IN FEET FOR STAGE


HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____		
	1	2616348	5-3/16" x 6"	58210	Item _____		
	2	2616348	4-13/16" x 5-5/8"	58259	Peerless Ref. No: _____		
	3				<b>Laboratory Performance</b>		
4				SIZE 8HXB	RPM 2900	BOWL 2616346 C.I.E.	CURVE 4806228

PUMP DESCRIPTION: Driver \_\_\_\_\_; Head \_\_\_\_\_; Column \_\_\_\_\_  
 BOWL  PERFORMANCE: Capacity \_\_\_\_\_ gpm; Head \_\_\_\_\_ ft; Eff \_\_\_\_\_ %; BHP \_\_\_\_\_  
 FIELD



Peerless Pump Company  
Indianapolis, IN 46207-7026

VERTICAL TURBINE PUMPS

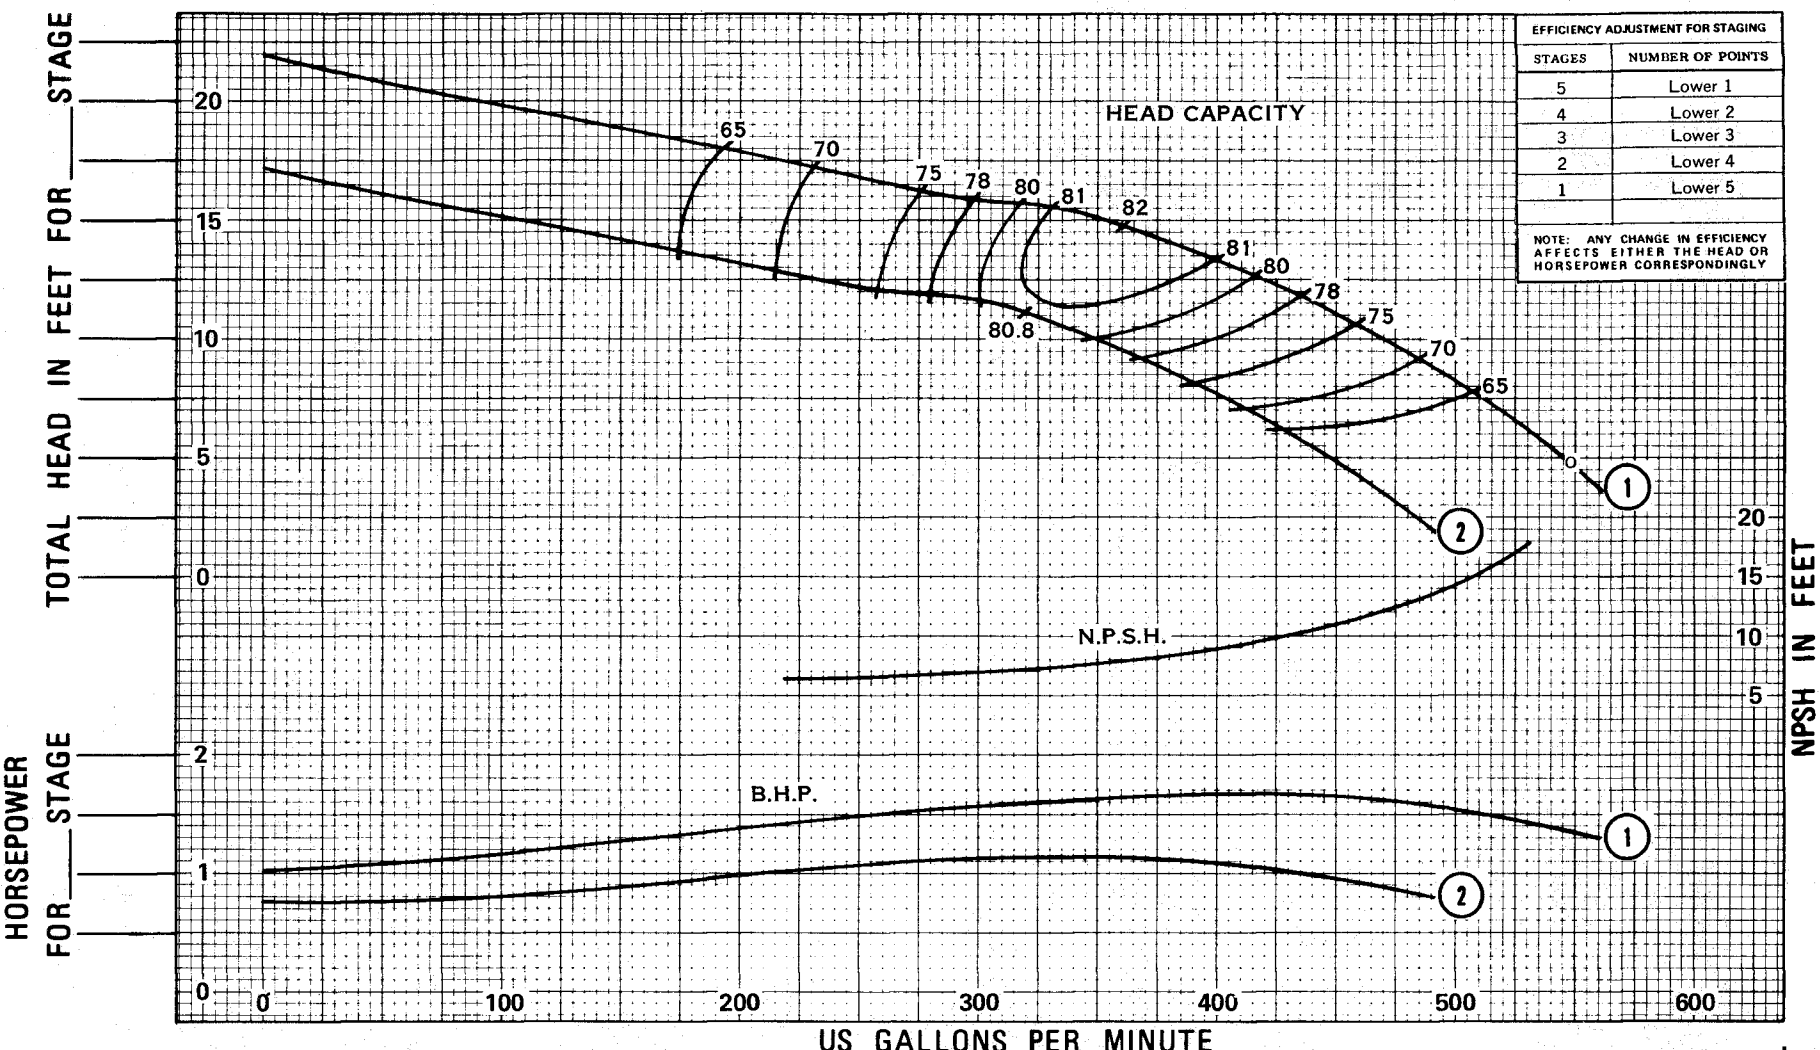

140-50Hz Page 33

HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____		
	1	2616348	5-3/16" x 6"	58210	Item _____		
	2	2616348	4-13/16" x 5-5/8"	58259	Peerless Ref. No: _____		
	3				<b>Laboratory Performance</b>		
4				SIZE 8HXB	RPM 1460	BOWL 2616346 C.I.E.	CURVE 4806229

PUMP DESCRIPTION: Driver \_\_\_\_\_; Head \_\_\_\_\_; Column \_\_\_\_\_  
 BOWL  PERFORMANCE: Capacity \_\_\_\_\_ gpm; Head \_\_\_\_\_ ft; Eff \_\_\_\_\_ %; BHP \_\_\_\_\_  
 FIELD