




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 10MA-1760 Rpm

SECTION 140
Page 1760-27
May, 1985

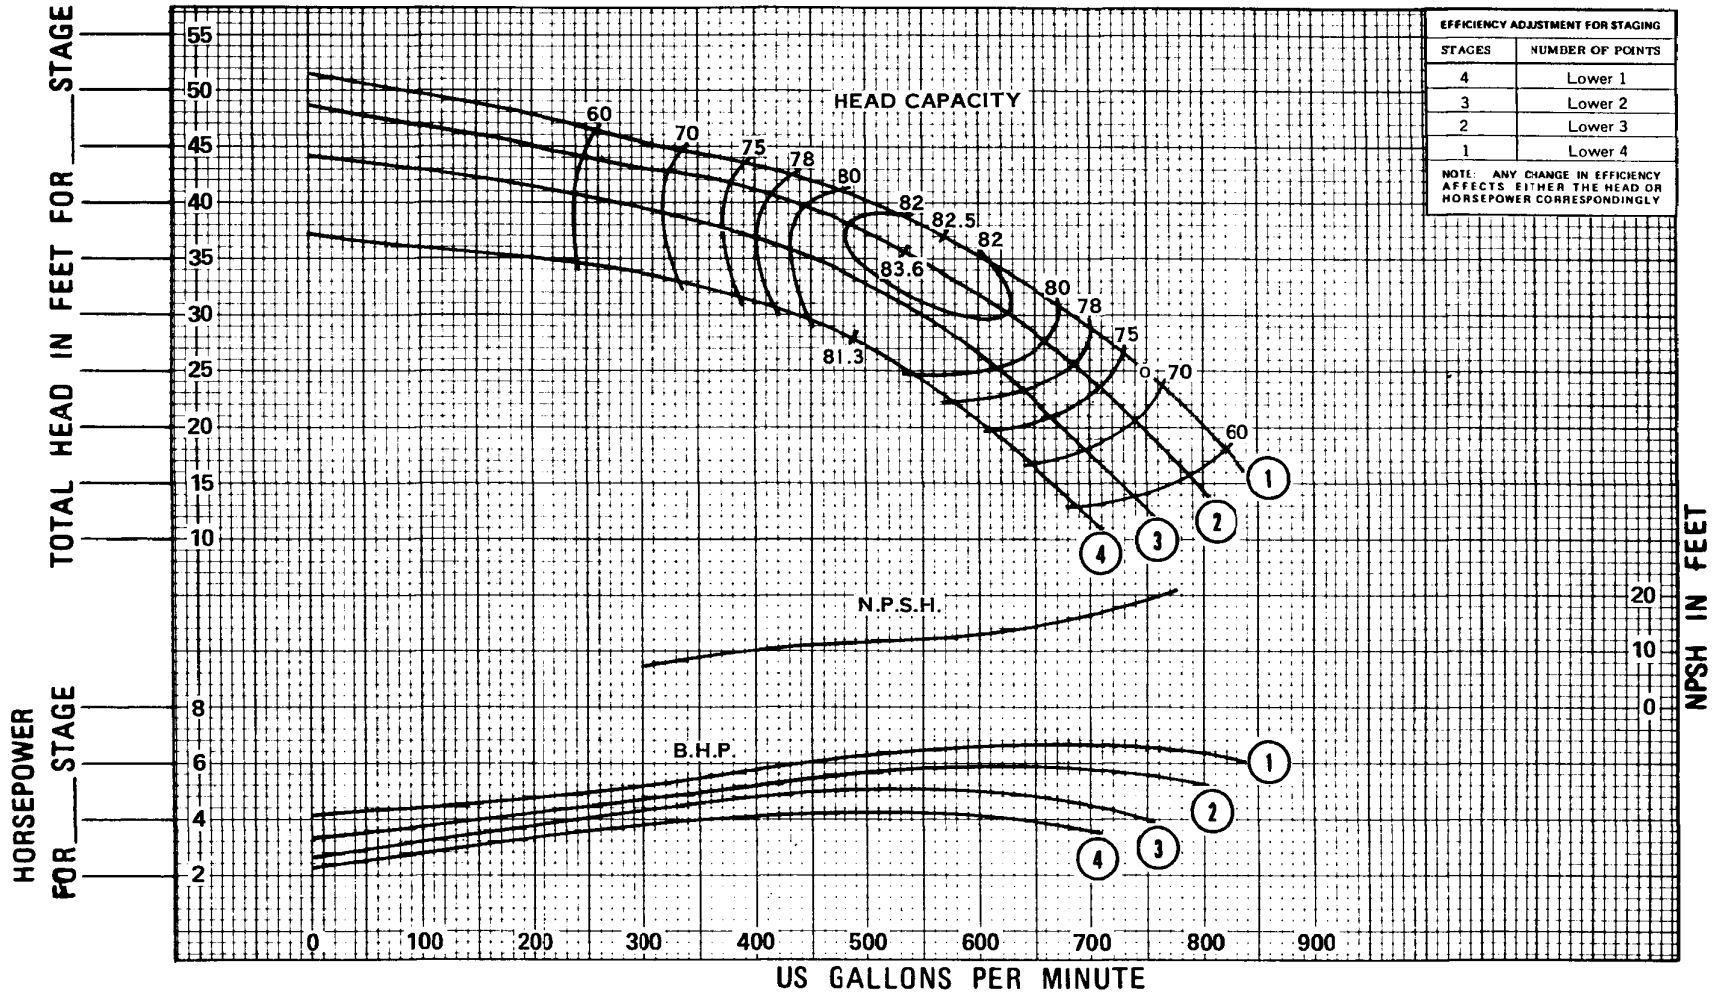


| HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ |
|--|-----------|--------------|------------------------|------------|--|
| | 1 | T84363 | UNDERCUT 7-1/8" | 58076 | Item _____ |
| | 2 | T84363 | STANDARD FILING 7-1/8" | 58356 | Peerless Ref. No: _____ |
| | 3 | T84363 | 7" | _____ | Laboratory Performance |
| 4 | T84363 | 6-5/8" | 26863 | _____ | SIZE 10MA RPM 1760 BOWL T-84232-C.I.E. CURVE 48C6183 |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD

VERTICAL TURBINE PUMPS
Model 10MA - 1760 Rpm



Peerless Pump Company
Indianapolis, IN 46207-7025

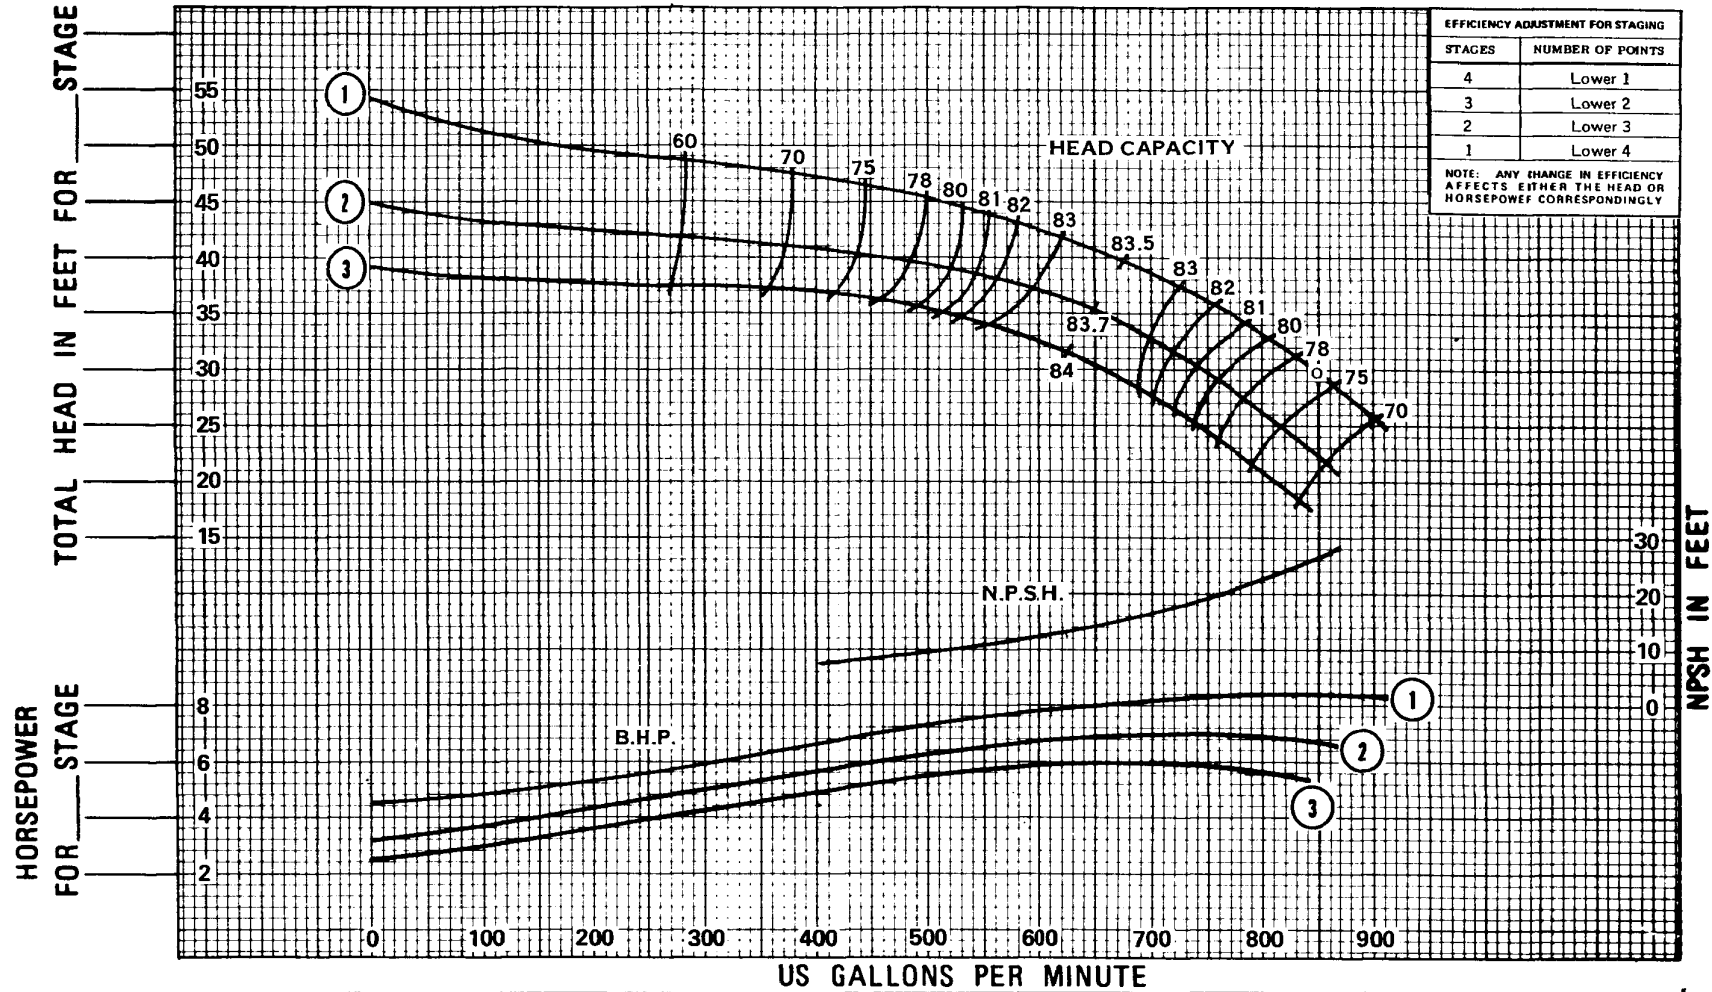

| HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ |
|--|-----------|--------------|---------------|------------|---|
| | 1 | 2624288 | 7-1/8" | 58416 | Item _____ |
| | 2 | 2624288 | 6-7/8" | 58836 | Peerless Ref. No: _____ |
| | 3 | 2624288 | 6-5/8" | 58921 | Laboratory Performance |
| 4 | | | | | SIZE 10MA RPM 1760 BOWL T-84232-C.I.E. CURVE 4806250 |


PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 10MA - 1160 Rpm

SECTION 140
Page 1160-3
May, 1985

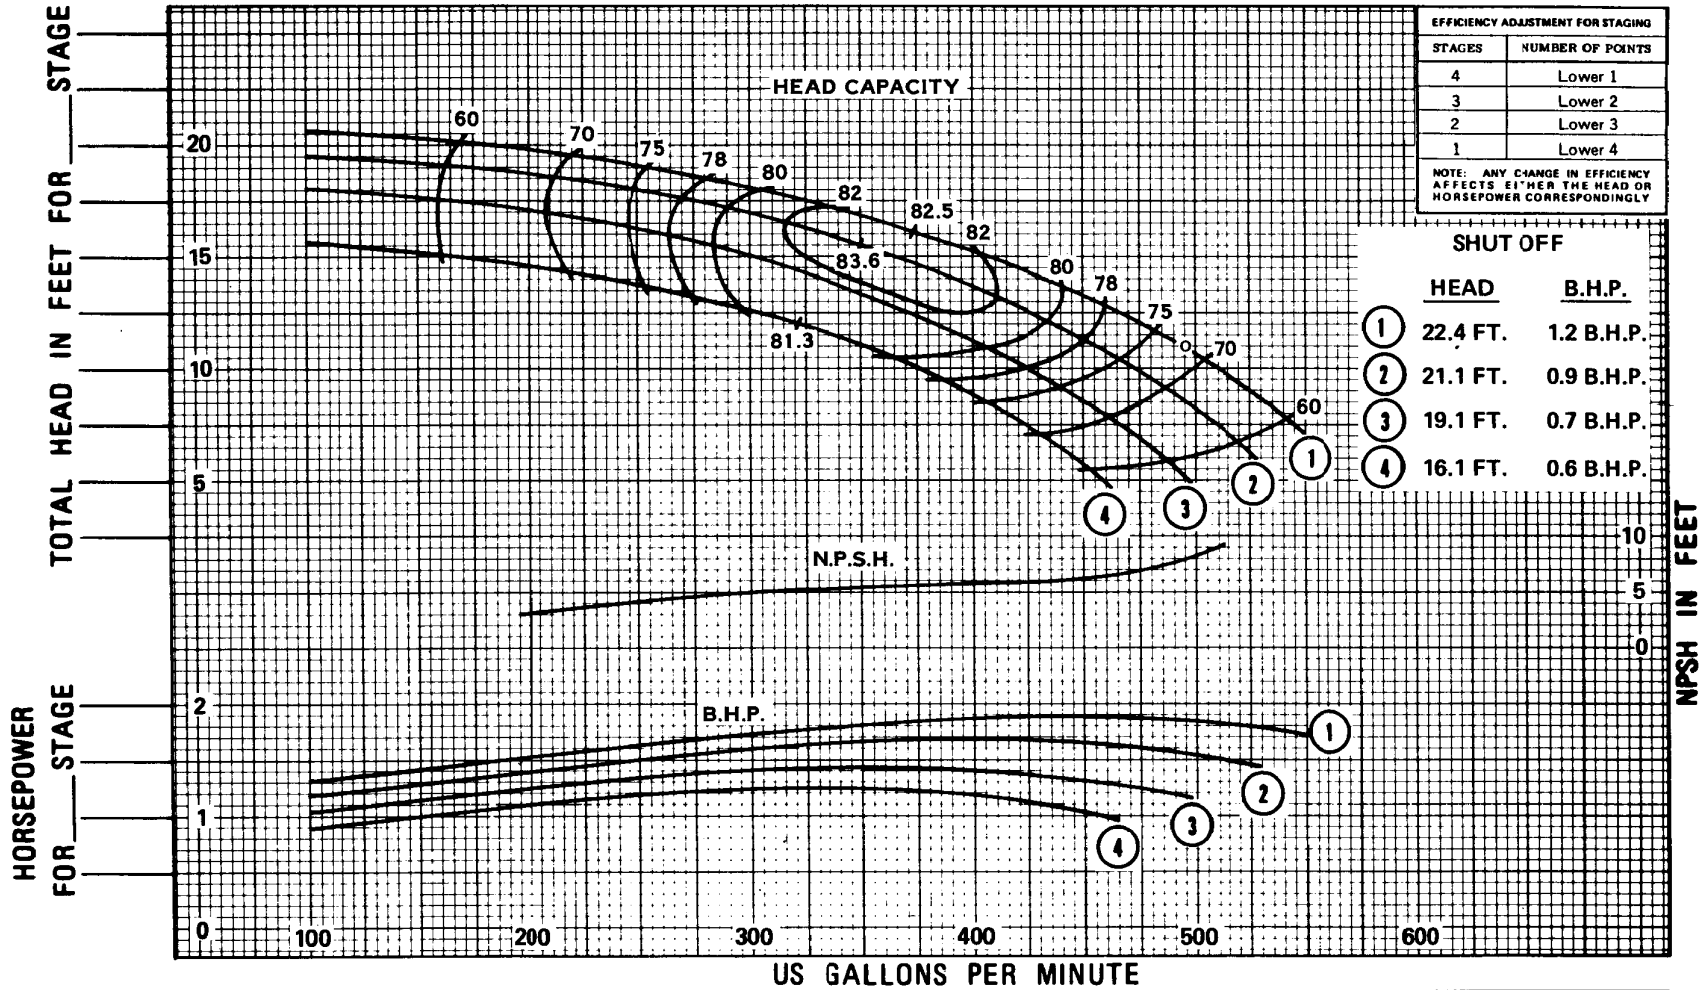


| | | | | | | | | | | | |
|---|-----------|---------------------|---------------------------|------------|--|-----------|----------|---------------------|--|--|---------------|
| Head and Capacity Warranty Contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ | | | | | | |
| | 1 | T84363 | UNDERCUT 7-1/8" | 58076 | Item _____ | | | | | | |
| | 2 | T84363 | STANDARD FILING 7-1/8" | 58356 | Peerless Ref. No: _____ | | | | | | |
| | 3 | T84363 | 7" | _____ | Laboratory Performance | | | | | | |
| | 4 | T84363 | 6-5/8" | 26863 | <table border="1"> <tr> <td>SIZE 10MA</td> <td>RPM 1160</td> <td>BOWL T-84232-C.I.E.</td> </tr> <tr> <td></td> <td></td> <td>CURVE 4806185</td> </tr> </table> | SIZE 10MA | RPM 1160 | BOWL T-84232-C.I.E. | | | CURVE 4806185 |
| SIZE 10MA | RPM 1160 | BOWL T-84232-C.I.E. | | | | | | | | | |
| | | CURVE 4806185 | | | | | | | | | |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD

VERTICAL TURBINE PUMPS
Model 10MA - 1160 Rpm



Peerless Pump Company
Indianapolis, IN 46207-7025

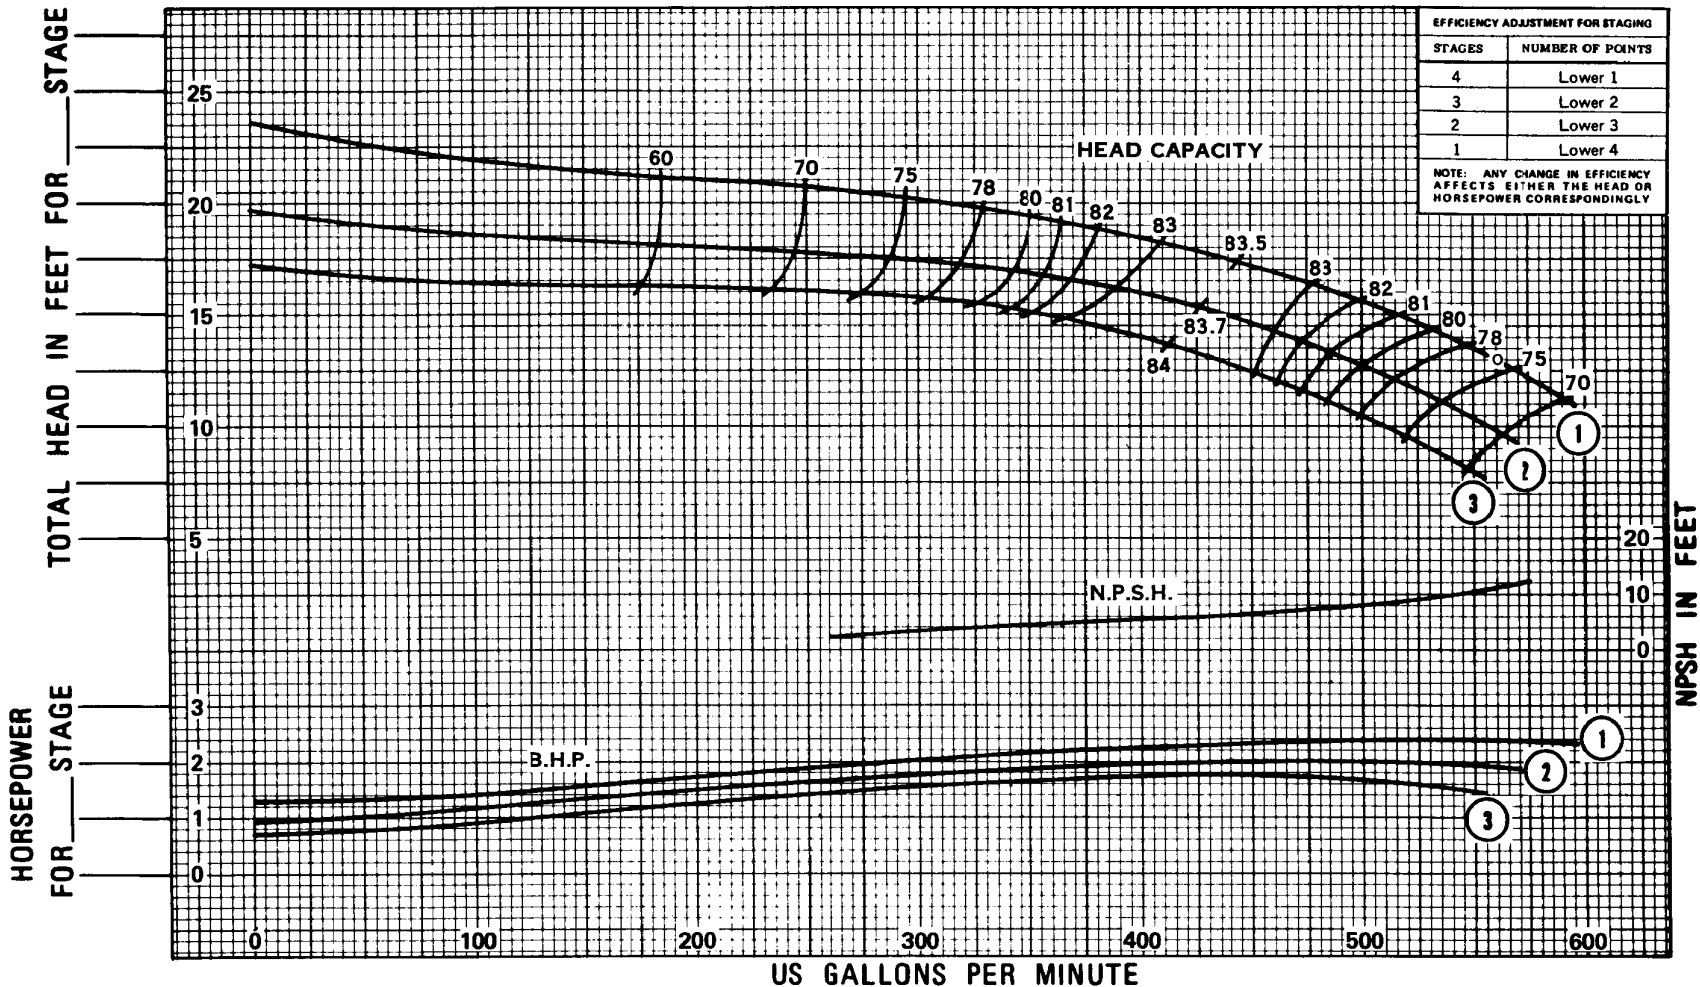

| EFFICIENCY ADJUSTMENT FOR STAGING | |
|-----------------------------------|------------------|
| STAGES | NUMBER OF POINTS |
| 4 | Lower 1 |
| 3 | Lower 2 |
| 2 | Lower 3 |
| 1 | Lower 4 |

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

| Head and Capacity Warranty Contingent on: | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ |
|--|-----------|--------------|---------------|------------|---|
| | 1 | 2624288 | 7-1/8" | 58416 | Item _____ |
| | 2 | 2624288 | 6-7/8" | 58836 | Peerless Ref. No: _____ |
| | 3 | 2624288 | 6-5/8" | 58921 | Laboratory Performance |
| 4 | | | | | SIZE 10MA RPM 1160 BOWL T-84232-C.I.E. CURVE 4806251 |


PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS

TOTAL HEAD IN FEET FOR STAGE
HORSEPOWER FOR STAGE

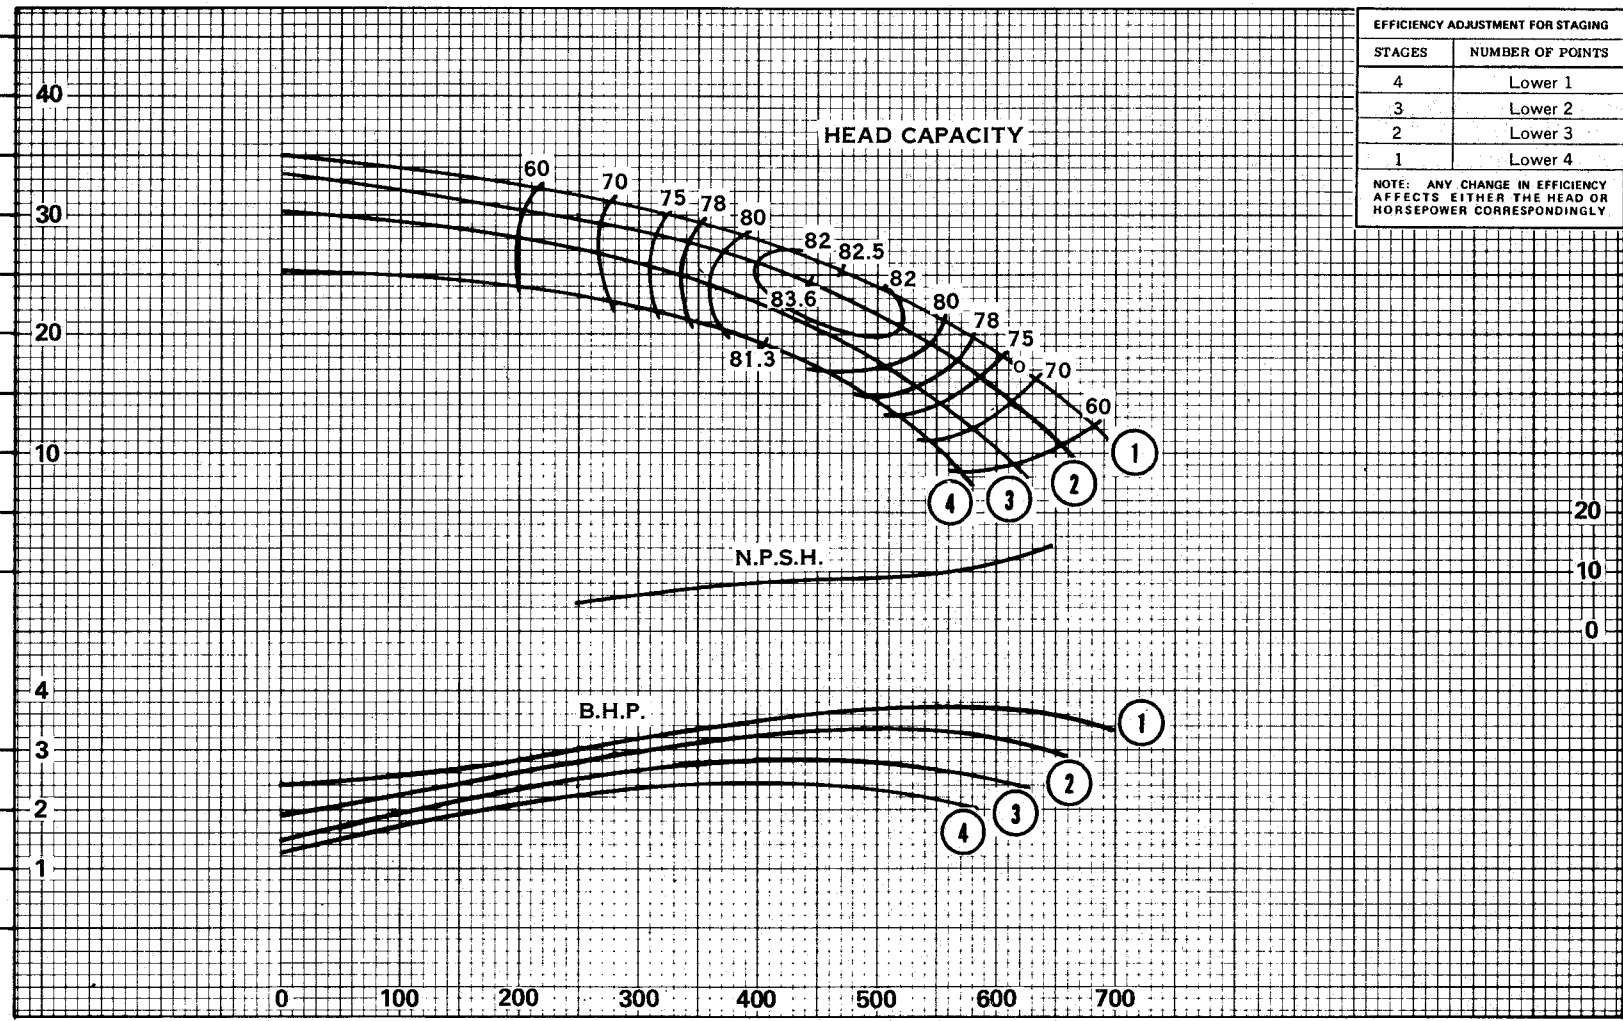

| EFFICIENCY ADJUSTMENT FOR STAGING | |
|-----------------------------------|------------------|
| STAGES | NUMBER OF POINTS |
| 4 | Lower 1 |
| 3 | Lower 2 |
| 2 | Lower 3 |
| 1 | Lower 4 |

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

FEET IN HSN

140-50Hz Page 39

| HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ | | |
|---|-----------|--------------|------------------------|------------|-------------------------------|--------------------------------------|--|
| | 1 | T84363 | UNDERCUT 7-1/8" | 58076 | Item _____ | | |
| | 2 | T84363 | STANDARD FILING 7-1/8" | 58356 | Peerless Ref. No: _____ | | |
| | 3 | T84363 | 7" | --- | Laboratory Performance | | |
| 4 | T84363 | 6-5/8" | 26863 | SIZE 10MA | RPM 1460 | BOWL T-84232-C.I.E. CURVE 4806184 | |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD


VERTICAL TURBINE PUMPS



Peerless Pump Company
Indianapolis, IN 46207-7025

| EFFICIENCY ADJUSTMENT FOR STAGING | |
|-----------------------------------|------------------|
| STAGES | NUMBER OF POINTS |
| 4 | Lower 1 |
| 3 | Lower 2 |
| 2 | Lower 3 |
| 1 | Lower 4 |

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

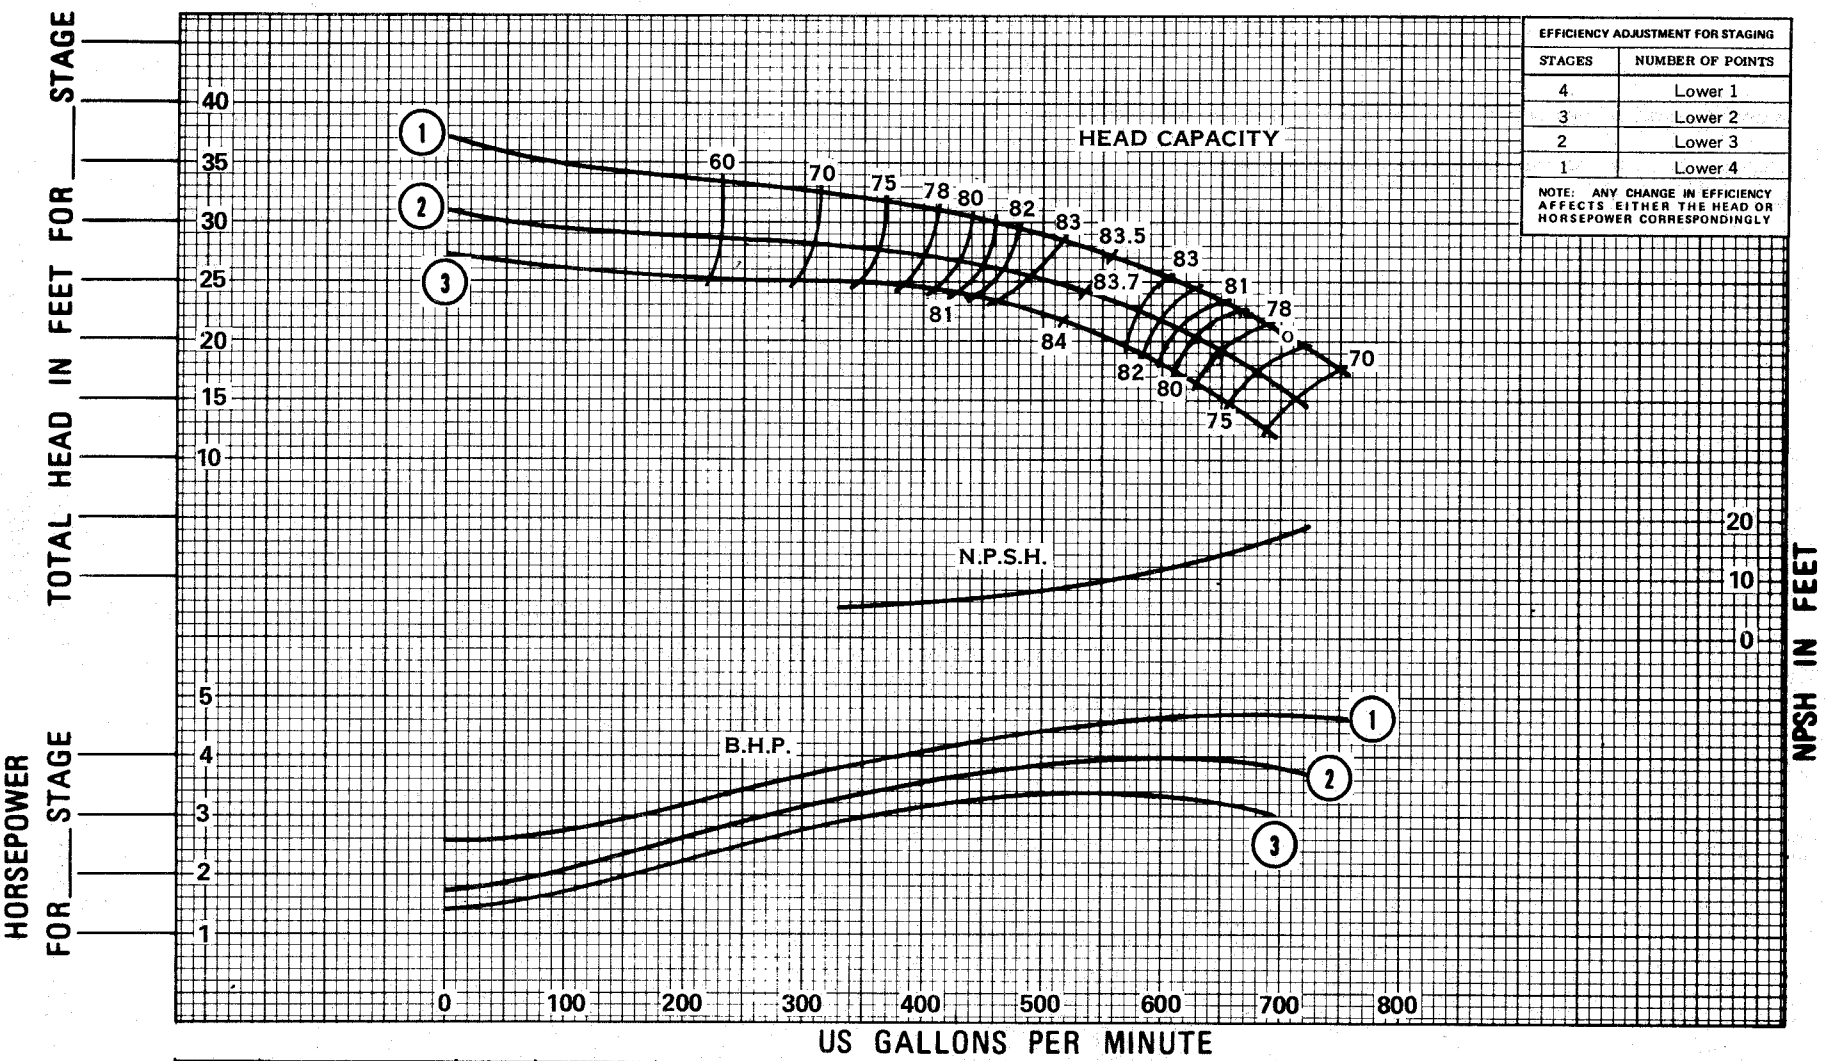

| HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ |
|---|-----------|--------------|---------------|------------|---|
| | 1 | 2624288 | 7-1/8" | 58416 | Item _____ |
| | 2 | 2624288 | 6-7/8" | 58836 | Peerless Ref. No: _____ |
| | 3 | 2624288 | 6-5/8" | 58921 | Laboratory Performance |
| 4 | | | | | SIZE 10MA RPM 1460 BOWL T-84232-C.I.E. CURVE 4806252 |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS

Section 140
5-85

| EFFICIENCY ADJUSTMENT FOR STAGING | |
|-----------------------------------|------------------|
| STAGES | NUMBER OF POINTS |
| 4 | Lower 1 |
| 3 | Lower 2 |
| 2 | Lower 3 |
| 1 | Lower 4 |

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

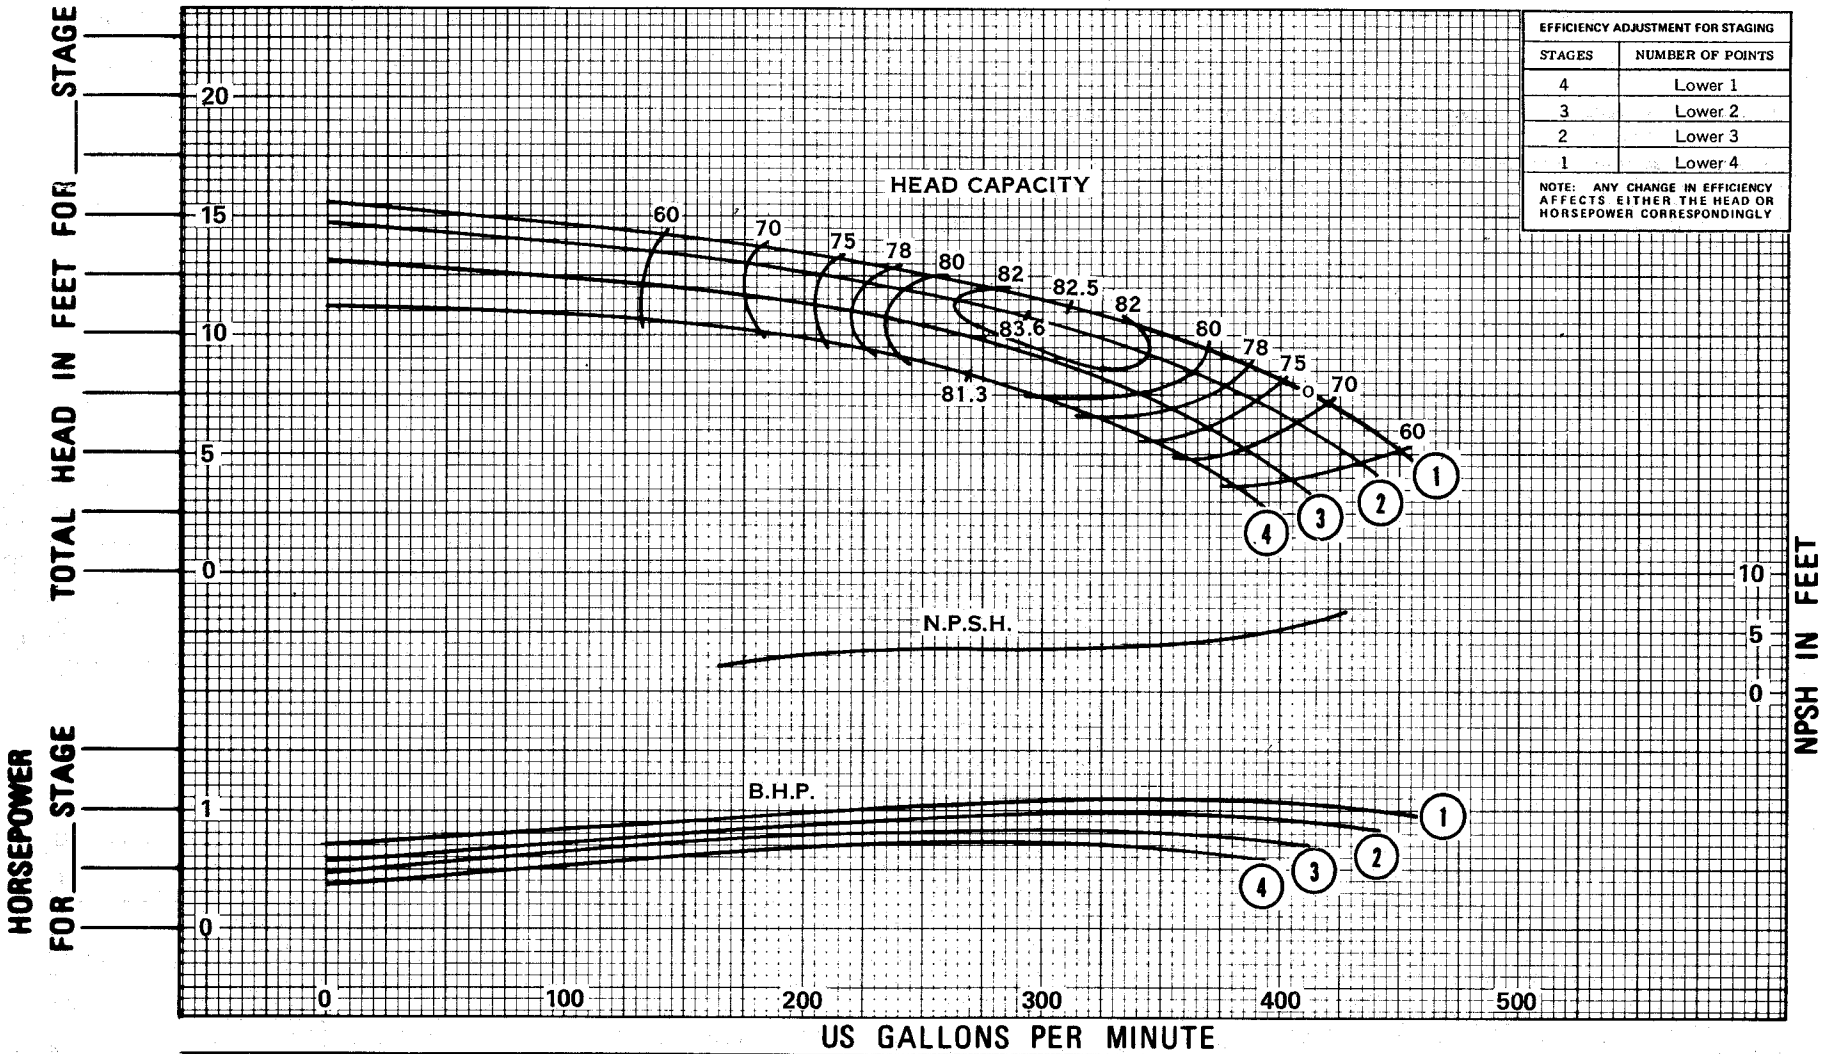


| HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ | | |
|---|-----------|--------------|------------------------|------------|-------------------------------|---------------------|---------------|
| | 1 | T84363 | UNDERCUT 7-1/8" | 58076 | Item _____ | | |
| | 2 | T84363 | STANDARD FILING 7-1/8" | 58356 | Peerless Ref. No: _____ | | |
| | 3 | T84363 | 7" | _____ | Laboratory Performance | | |
| 4 | T84363 | 6-5/8" | 26863 | SIZE 10MA | RPM 970 | BOWL T-84232-C.I.E. | CURVE 4806186 |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD

VERTICAL TURBINE PUMPS



Peerless Pump Company
Indianapolis, IN 46207-7026

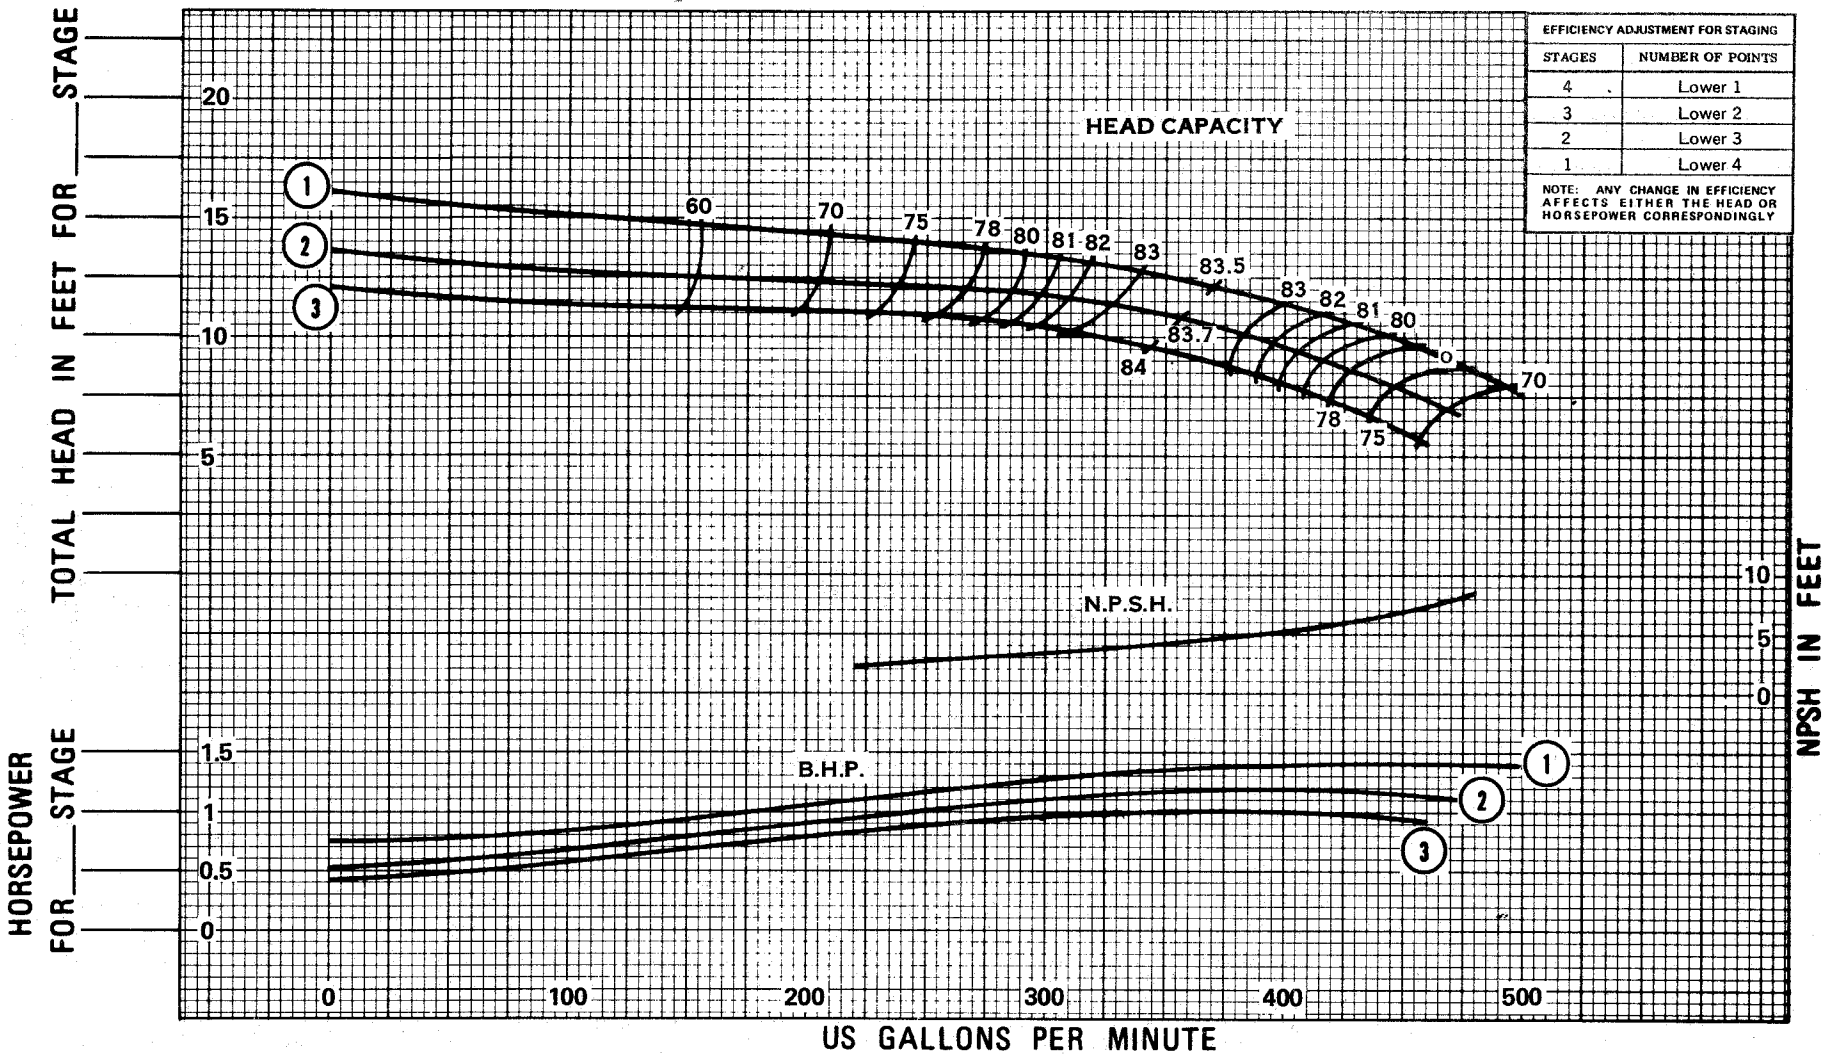

| HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller | CURVE NO. | IMPELLER NO. | IMPELLER DIA. | TAKEN FROM | Customer _____ |
|---|-----------|--------------|---------------|------------|--|
| | 1 | 2624288 | 7-1/8" | 58416 | Item _____ |
| | 2 | 2624288 | 6-7/8" | 58836 | Peerless Ref. No: _____ |
| | 3 | 2624288 | 6-5/8" | 58921 | Laboratory Performance |
| 4 | | | | | SIZE 10MA RPM 970 BOWL T-84232-C.I.E. CURVE 4806253 |

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL FIELD PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____