

Customer :

LaBour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 2x3-8 MTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **1750 RPM**, 60 Hz Electric  
Impeller Dia.: **8.38/5.5 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **4.75 hp**

Curve No.: **8196-014**


Impeller No.

Fluid: **Water**

Closed Valve Pressure **76.813 ft**

Item : **1**

Tolerance : **Hyd Inst-Peerless Std**

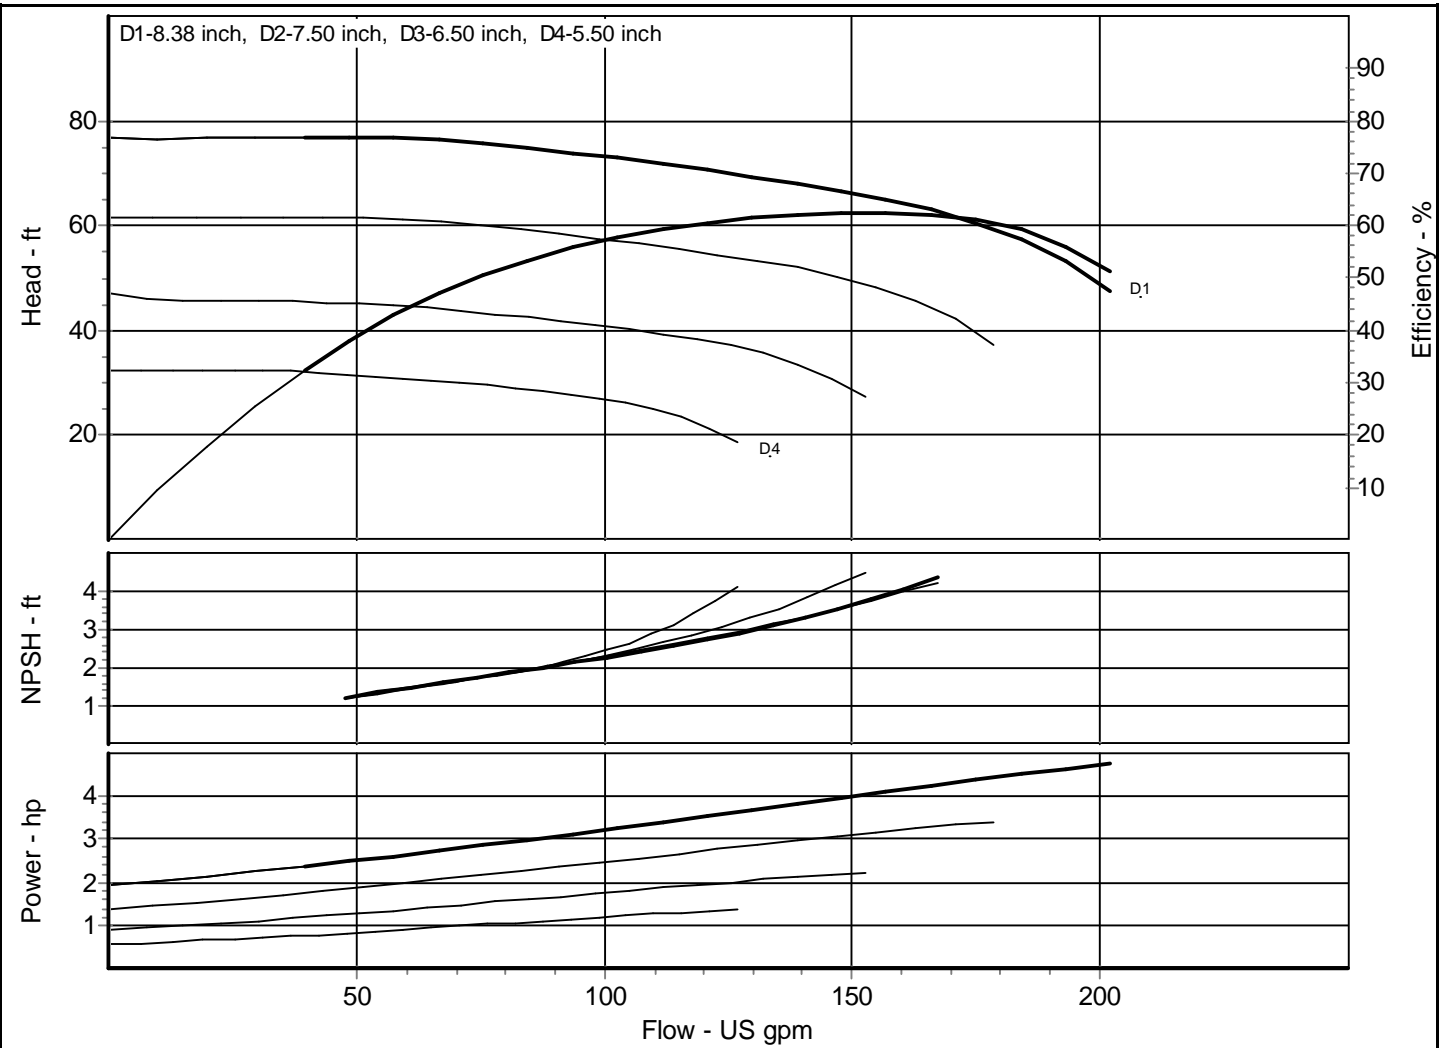

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

Customer :

LaBour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 2x3-8 MTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **3550 RPM, 60 Hz Electric**  
Impeller Dia.: **8.38/5.5 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **37.27 hp**

Curve No.: **8196-013**

Impeller No.


Item : **1**

Fluid: **Water**

Closed Valve Pressure **316.092 ft**

Your Ref.:

Tolerance : **Hyd Inst-Peerless Std**

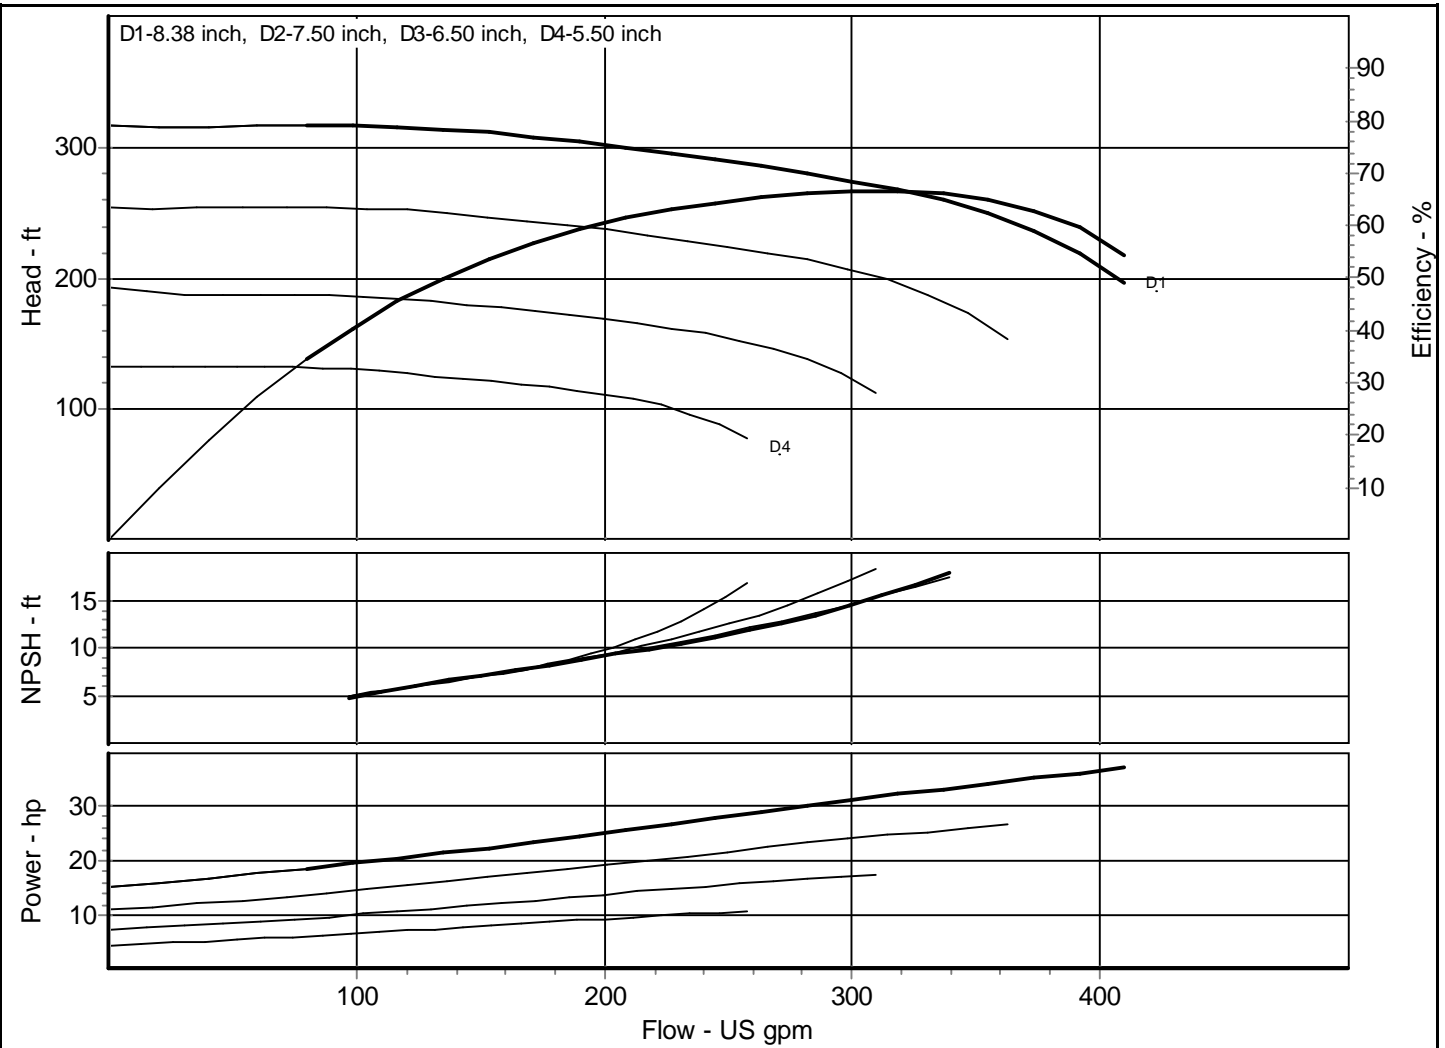

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.