

Customer :

LaBour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V LTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **1150 RPM, 60 Hz Electric**  
Impeller Dia.: **13/9 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft

Curve No.: **8196-037**

Impeller No.


Item : **1**

Your Ref.:

Fluid: **Water**

Peak Power: **11.51 hp**  
Closed Valve Pressure **77.727 ft**

Tolerance : **Hyd Inst-Peerless Std**

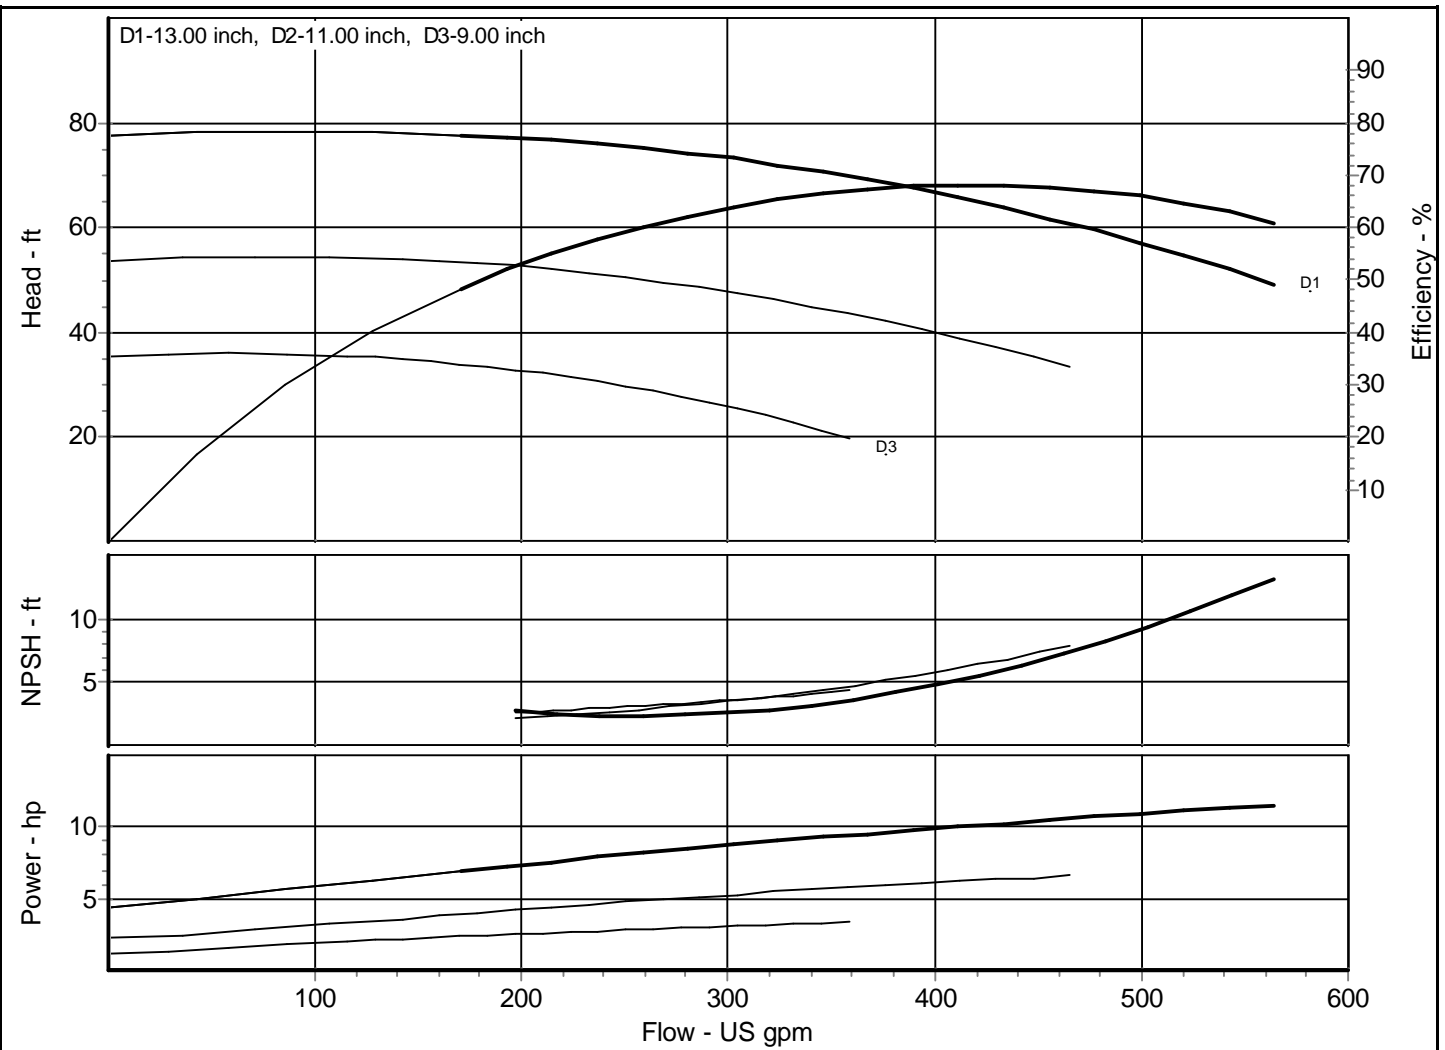

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

Customer :

LaBour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V MTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **1750 RPM, 60 Hz Electric**  
Impeller Dia.: **13/9 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **40 hp**

Curve No.: **8196-036**

Impeller No.


Item : **1**

Fluid: **Water**

Closed Valve Pressure **179.992 ft**

Your Ref.:

Tolerance : **Hyd Inst-Peerless Std**

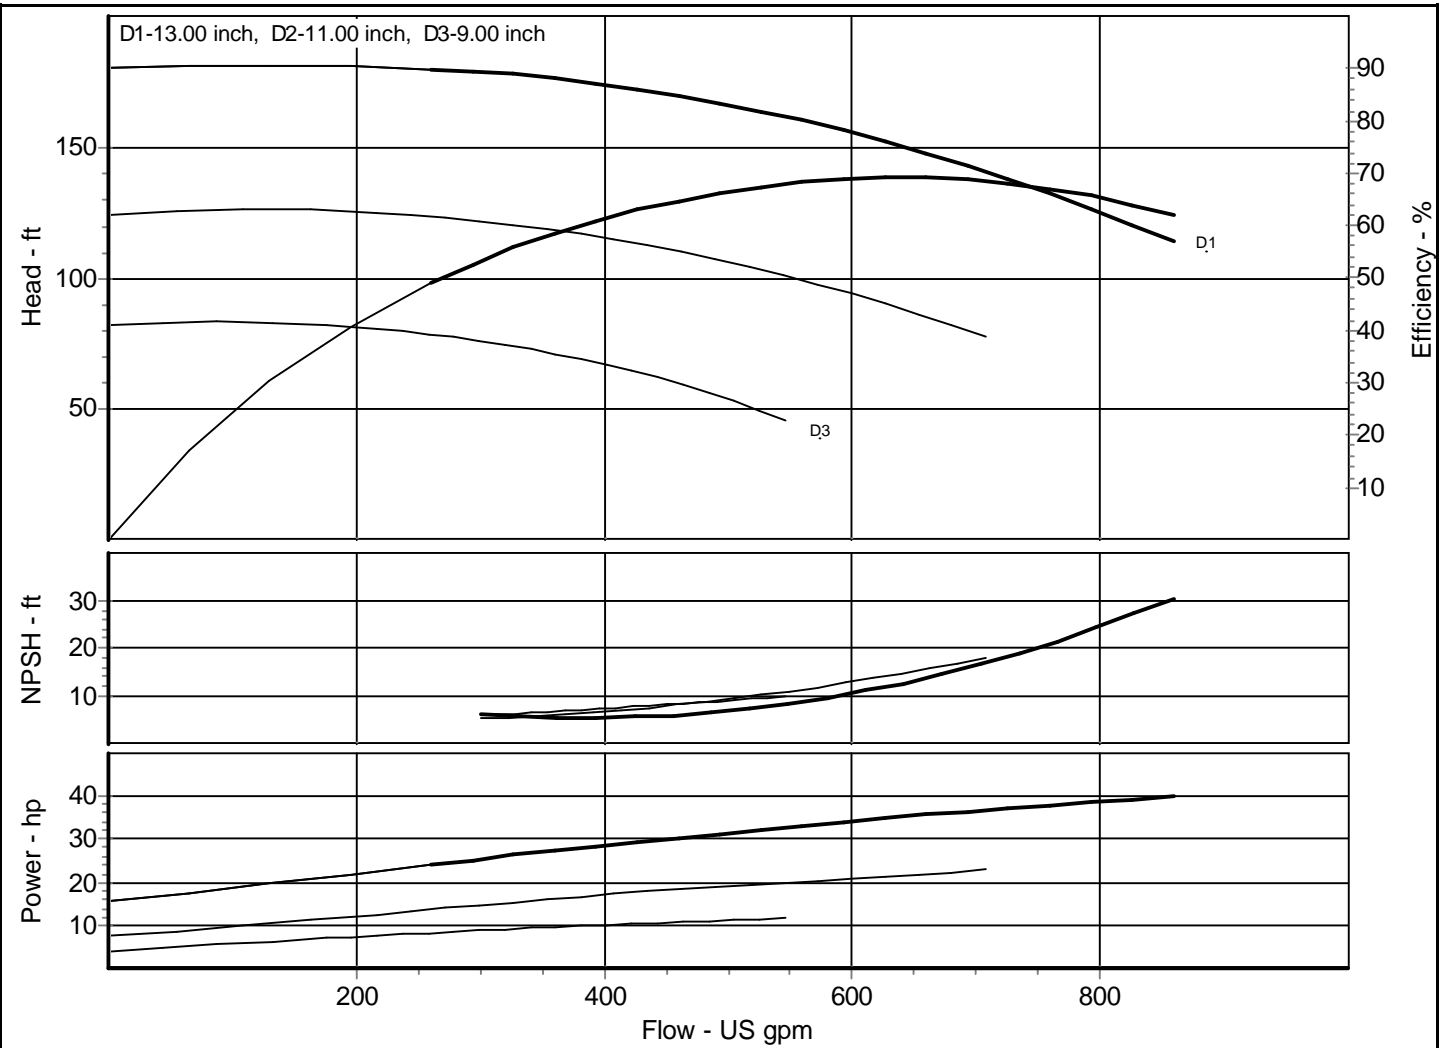

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

Customer :

Labour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V MTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **1150 RPM, 60 Hz Electric**  
Impeller Dia.: **13/9 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft

Curve No.: **8196-037**

Impeller No.


Item : **1**

Fluid: **Water**

Peak Power: **11.51 hp**  
Closed Valve Pressure **77.727 ft**

Your Ref.:

Tolerance : **Hyd Inst-Peerless Std**

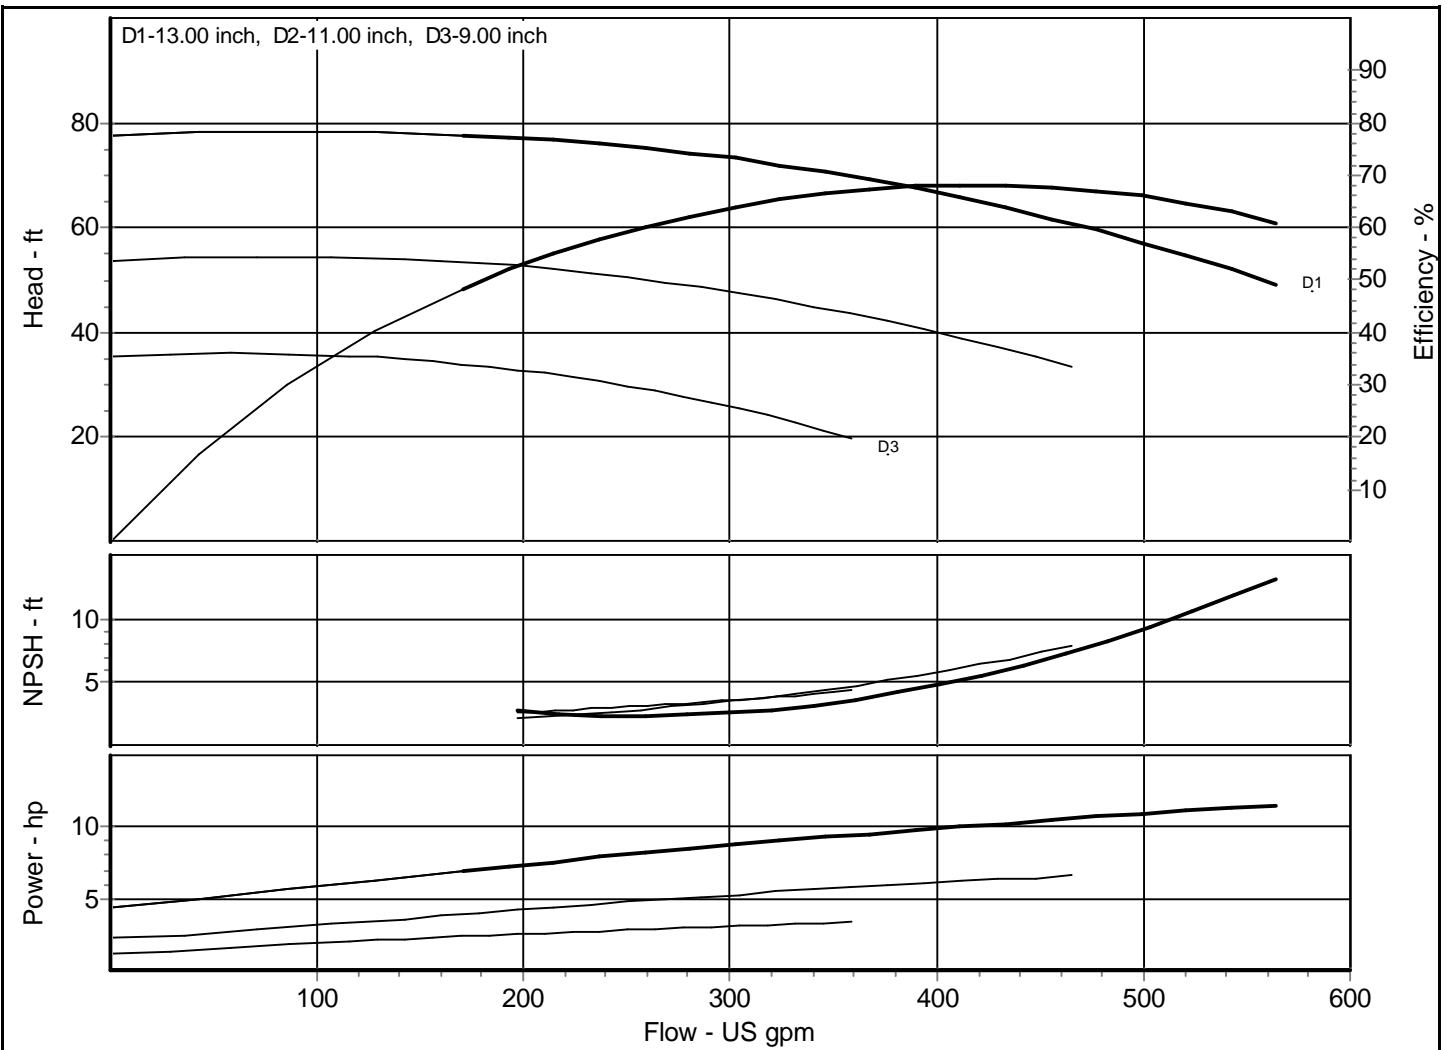

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

Customer :

Labour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V LTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **3550 RPM, 60 Hz Electric**  
Impeller Dia.: **10/7 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **134.1 hp**

Curve No.: **8196-035**


Impeller No.

Fluid: **Water**

Closed Valve Pressure **422.993 ft**

Item : 1

Tolerance : **Hyd Inst-Peerless Std**

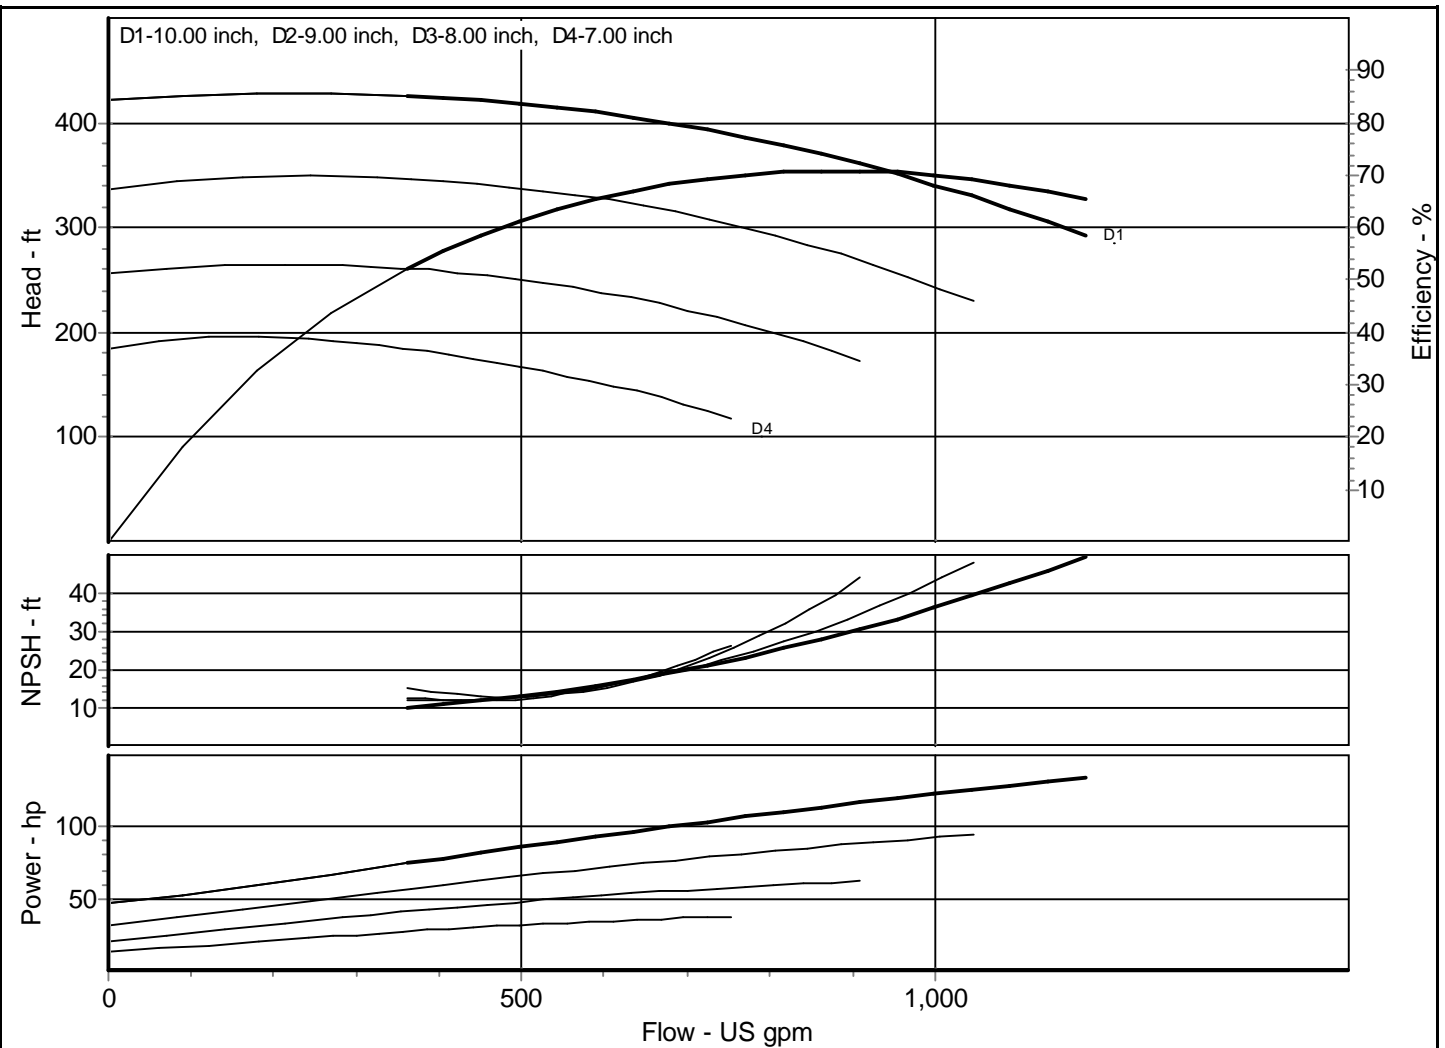

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.



Customer :

Labour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V LTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **1750 RPM, 60 Hz Electric**  
Impeller Dia.: **13/9 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **40 hp**

Curve No.: **8196-036**

Impeller No.


Item : **1**

Fluid: **Water**

Closed Valve Pressure **179.992 ft**

Your Ref.:

Tolerance : **Hyd Inst-Peerless Std**

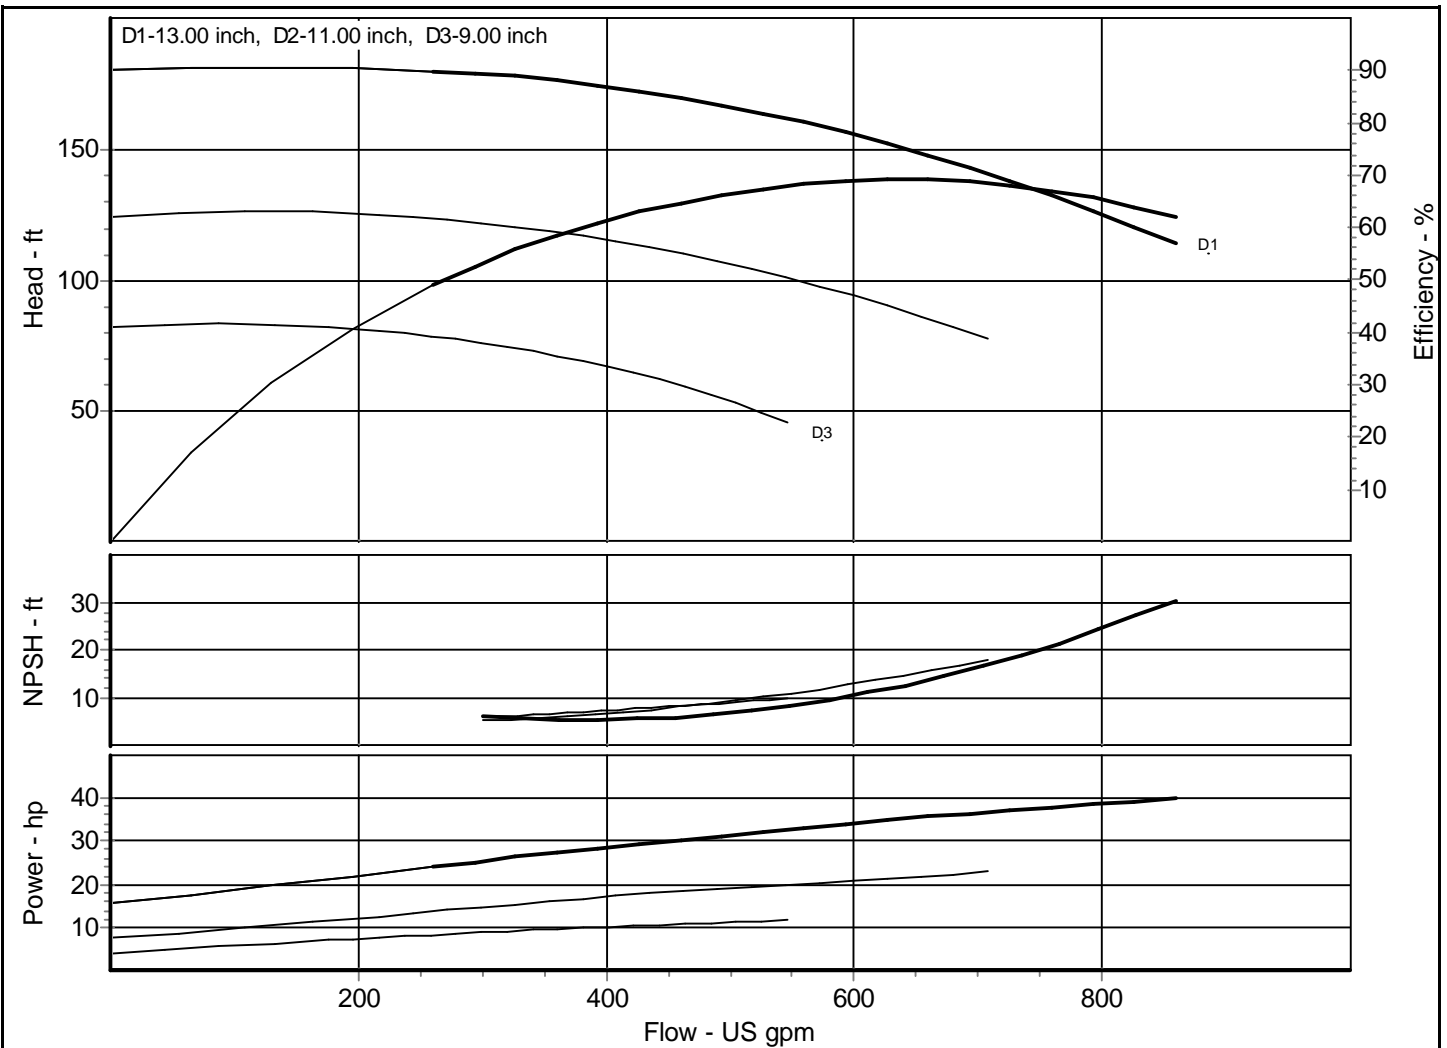

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

Customer :

Labour-Taber

2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :

Quote No. : US-2222-17

Page No. : 1

Contact :

Phone :

Fax :

Date : Wednesday, April 16, 2003

Pump Model: **LaBour - 3x4-13 5V MTP LVB**  
Type: **LVB - ANSI Standard End Suction**

Nom. Speed: **3550 RPM, 60 Hz Electric**  
Impeller Dia.: **10/7 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft  
Peak Power: **134.1 hp**

Curve No.: **8196-035**


Impeller No.

Fluid: **Water**

Closed Valve Pressure **422.993 ft**

Item : **1**

Tolerance : **Hyd Inst-Peerless Std**

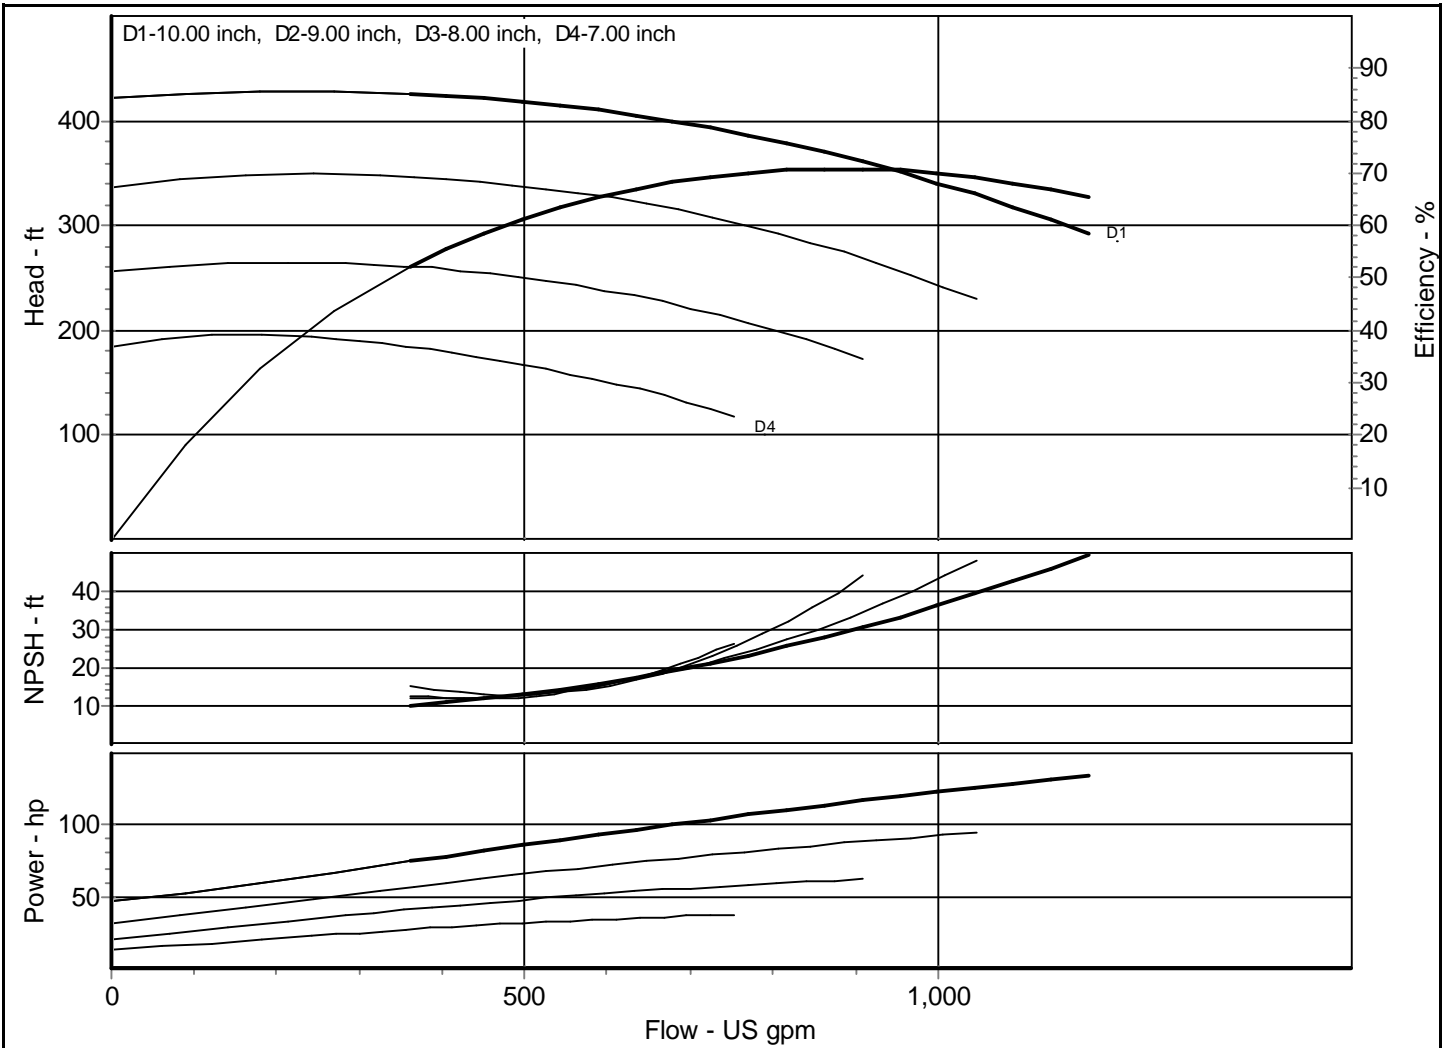

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.