


Customer :

Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

<b>Project :</b>		<b>Contact :</b>	
<b>Quote No. :</b> US-2222-17	<b>Page No. :</b> 1	<b>Phone :</b>	<b>Fax :</b>
		<b>Date :</b> Monday, April 14, 2003	
<b>Pump Model:</b> Peerless - 2x3-10 LTP 8196	<b>Nom. Speed:</b> 1750 RPM, 60 Hz Electric	<b>Duty Flow :</b>	US gpm
<b>Type:</b> 8196 - ANSI Standard End Suction	<b>Impeller Dia.:</b> 10/6 inch	<b>Duty Head :</b>	ft
	<b>Temperature:</b> 68 °F	<b>Efficiency :</b>	%
	<b>Viscosity:</b> 1.009 cP	<b>Power Required :</b>	hp
<b>Curve No.:</b> 8196-024	<b>Sp. Gravity:</b> 1.000	<b>NPSH Required :</b>	ft
<b>Impeller No.:</b>	<b>Fluid:</b> Water	<b>Peak Power:</b>	10.23 hp
<b>Item :</b> 1		<b>Closed Valve Pressure</b>	110.545 ft
<b>Your Ref.:</b>	<b>Tolerance :</b> Hyd Inst-Peerless Std		

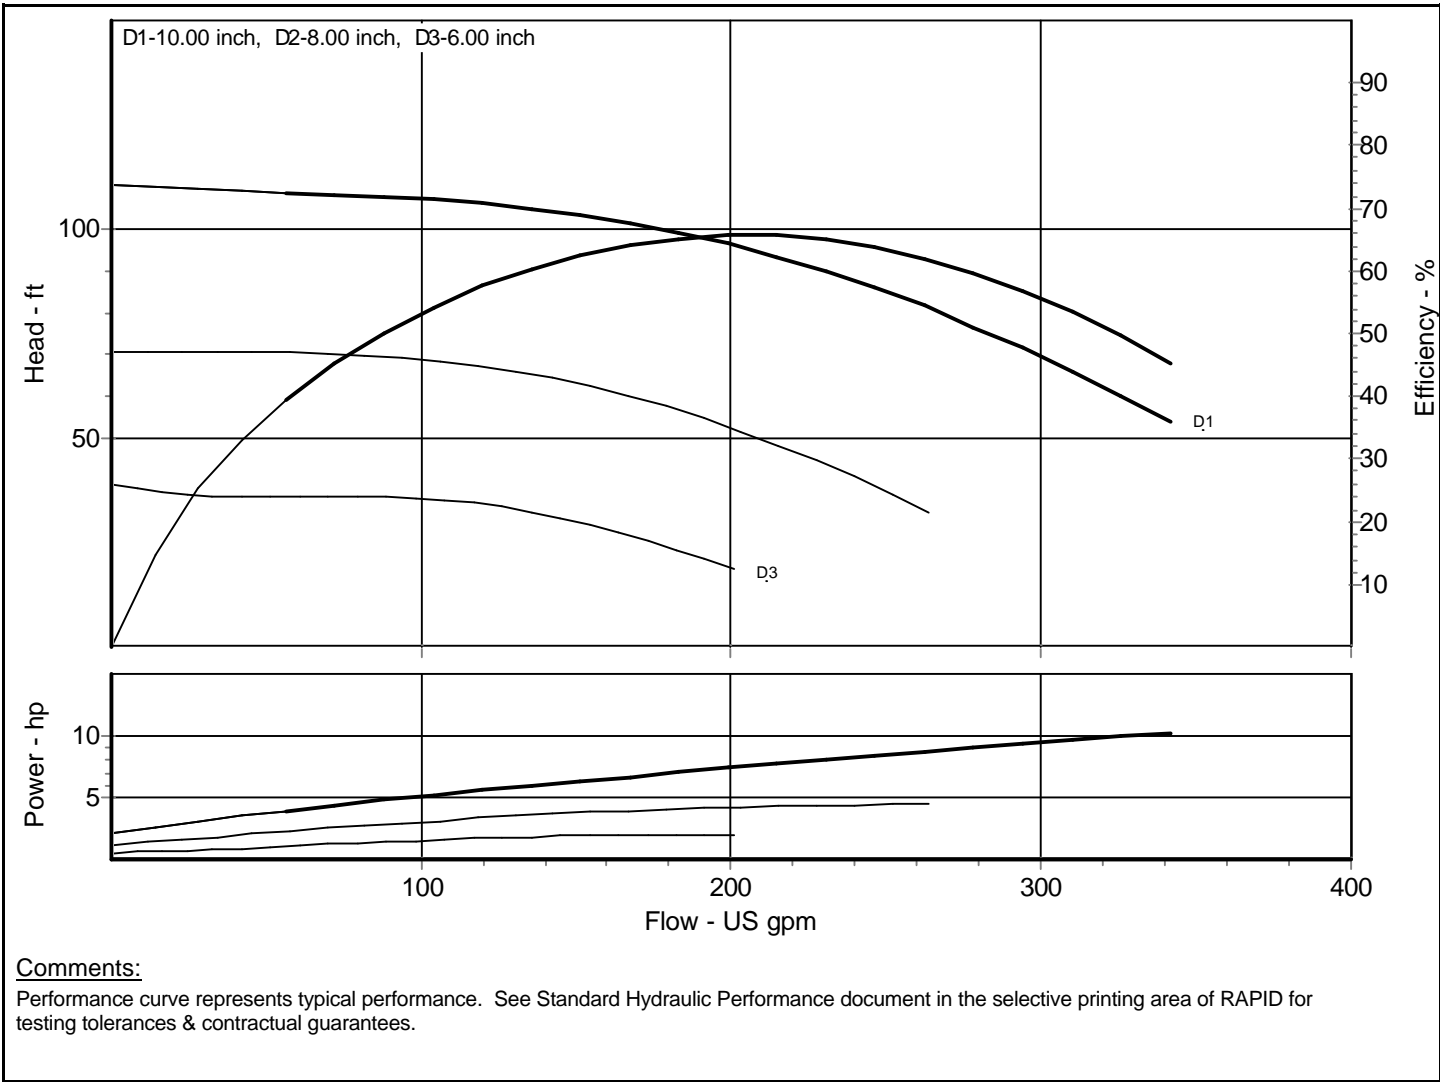

**Comments:**  
Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.



Customer :


Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :  
Quote No. : US-2222-17

Page No. : 1

Contact :  
Phone :  
Date : Monday, April 14, 2003  
Fax :


Pump Model:	<b>Peerless - 2x3-10 MTP 8196</b>	Nom. Speed:	<b>1750 RPM, 60 Hz Electric</b>	Duty Flow :	US gpm
Type:	<b>8196 - ANSI Standard End Suction</b>	Impeller Dia.:	<b>10/6 inch</b>	Duty Head :	ft
		Temperature:	<b>68 °F</b>	Efficiency :	%
		Viscosity:	<b>1.009 cP</b>	Power Required :	hp
Curve No.:	<b>8196-024</b>	Sp. Gravity:	<b>1.000</b>	NPSH Required :	ft
Impeller No.:		Fluid:	<b>Water</b>	Peak Power:	<b>10.23</b> hp
Item :	<b>1</b>			Closed Valve Pressure	<b>110.545</b> ft
Your Ref.:		Tolerance :	<b>Hyd Inst-Peerless Std</b>		

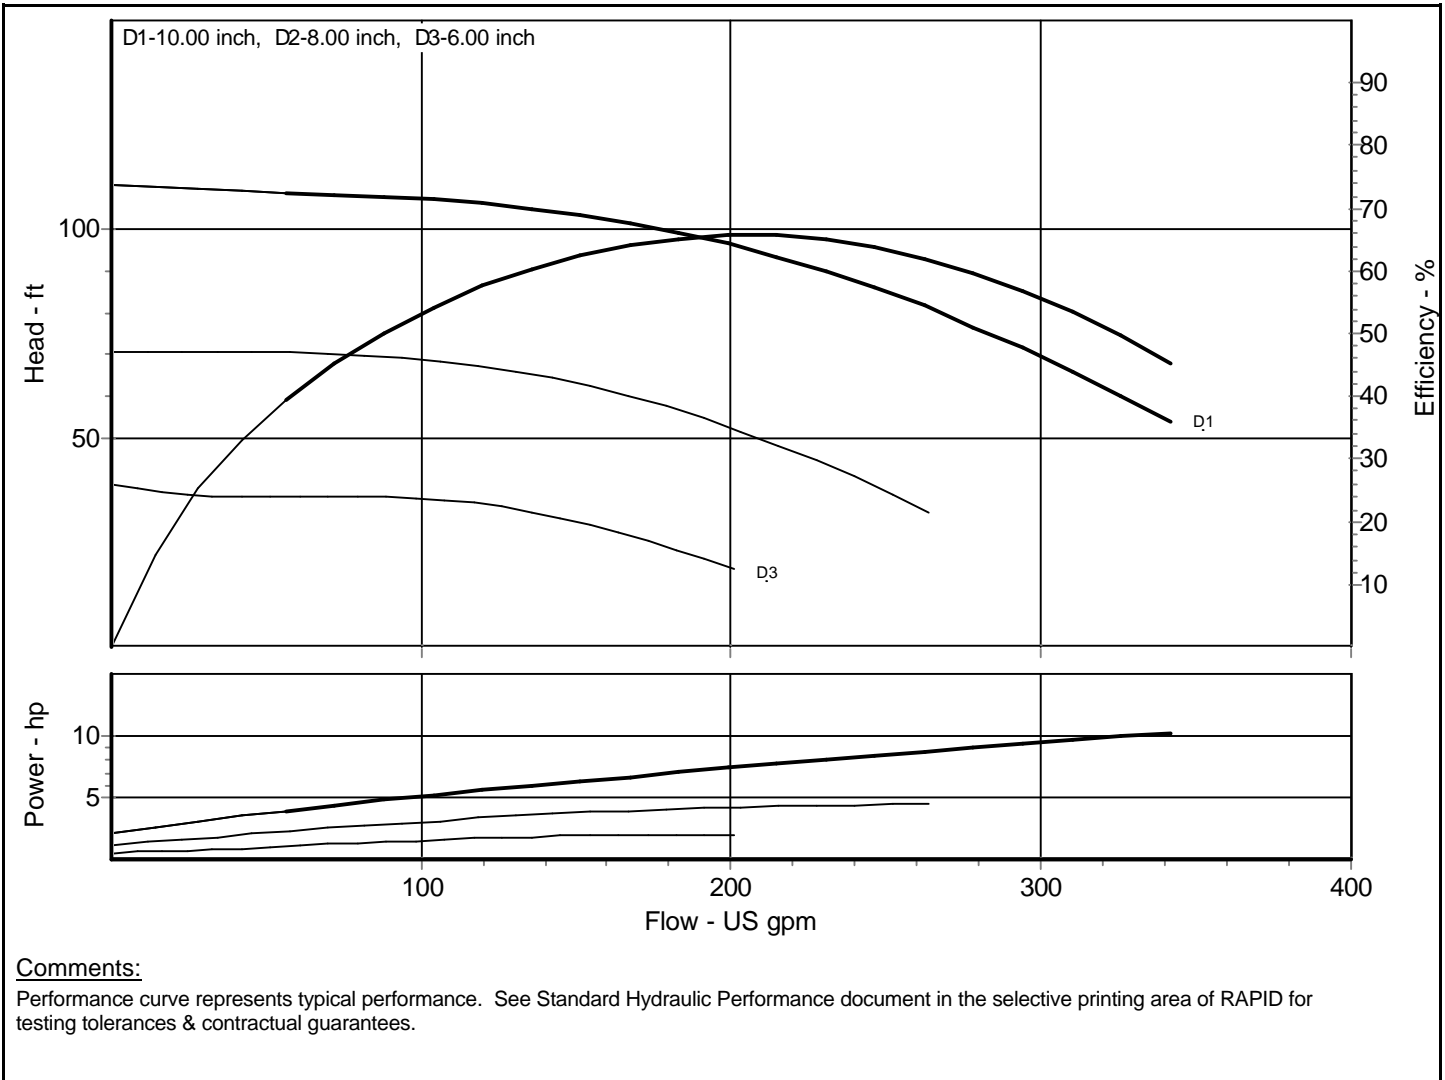

Customer :

Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

<b>Project :</b>		<b>Contact :</b>	
<b>Quote No. :</b> US-2222-17	<b>Page No. :</b> 1	<b>Phone :</b>	<b>Fax :</b>
		<b>Date :</b> Monday, April 14, 2003	
<b>Pump Model:</b> Peerless - 2x3-10 LTP 8196	<b>Nom. Speed:</b> 3550 RPM, 60 Hz Electric	<b>Duty Flow :</b>	US gpm
<b>Type:</b> 8196 - ANSI Standard End Suction	<b>Impeller Dia.:</b> 10/6 inch	<b>Duty Head :</b>	ft
	<b>Temperature:</b> 68 °F	<b>Efficiency :</b>	%
	<b>Viscosity:</b> 1.009 cP	<b>Power Required :</b>	hp
<b>Curve No.:</b> 8196-023	<b>Sp. Gravity:</b> 1.000	<b>NPSH Required :</b>	ft
<b>Impeller No.:</b>	<b>Fluid:</b> Water	<b>Peak Power:</b>	85.39 hp
<b>Item :</b> 1		<b>Closed Valve Pressure</b>	454.906 ft
<b>Your Ref.:</b>	<b>Tolerance :</b> Hyd Inst-Peerless Std		

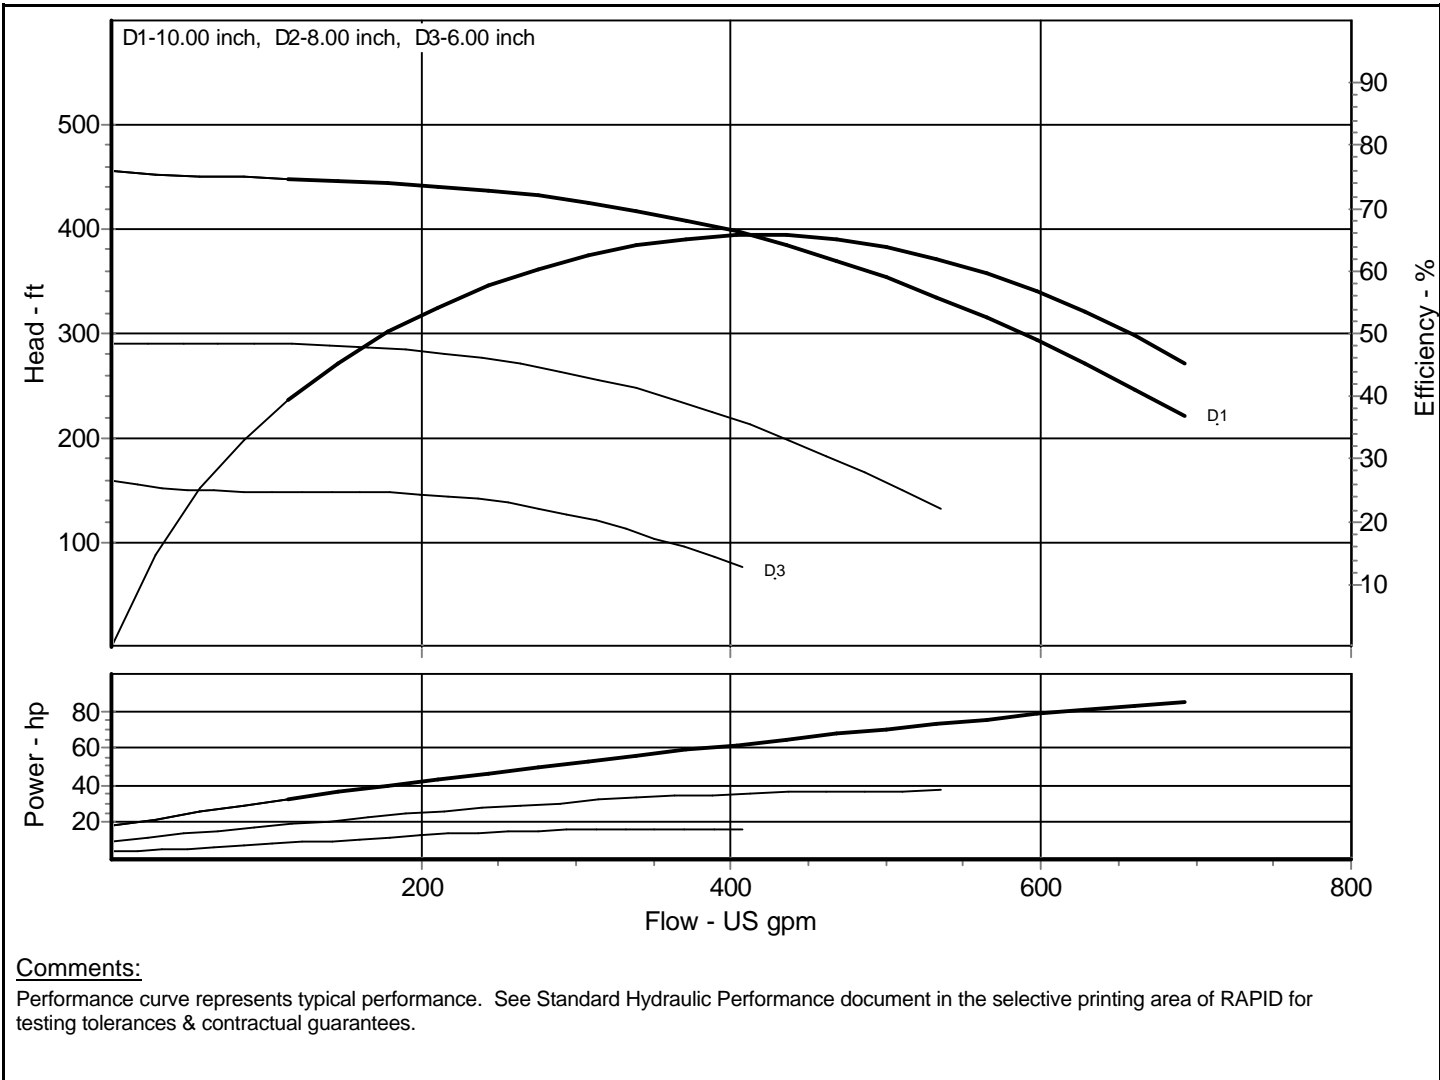

**Comments:**

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.



Customer :

Peerless Pump Company  
2005 Dr. Martin Luther King Jr. Street Indianapolis, Indiana

Project :  
Quote No. : US-2222-17

Page No. : 1

Contact :  
Phone :  
Date : Monday, April 14, 2003  
Fax :

Pump Model: **Peerless - 2x3-10 MTP 8196**  
Type: **8196 - ANSI Standard End Suction**

Nom. Speed: **3550 RPM, 60 Hz Electric**  
Impeller Dia.: **10/6 inch**

Duty Flow : US gpm  
Duty Head : ft  
Efficiency : %

Temperature: **68 °F**  
Viscosity: **1.009 cP**  
Sp. Gravity: **1.000**

Power Required : hp  
NPSH Required : ft

Curve No.: **8196-023**


Impeller No.

Fluid: **Water**

Peak Power: **85.39 hp**  
Closed Valve Pressure **454.906 ft**

Item : **1**

Tolerance : **Hyd Inst-Peerless Std**

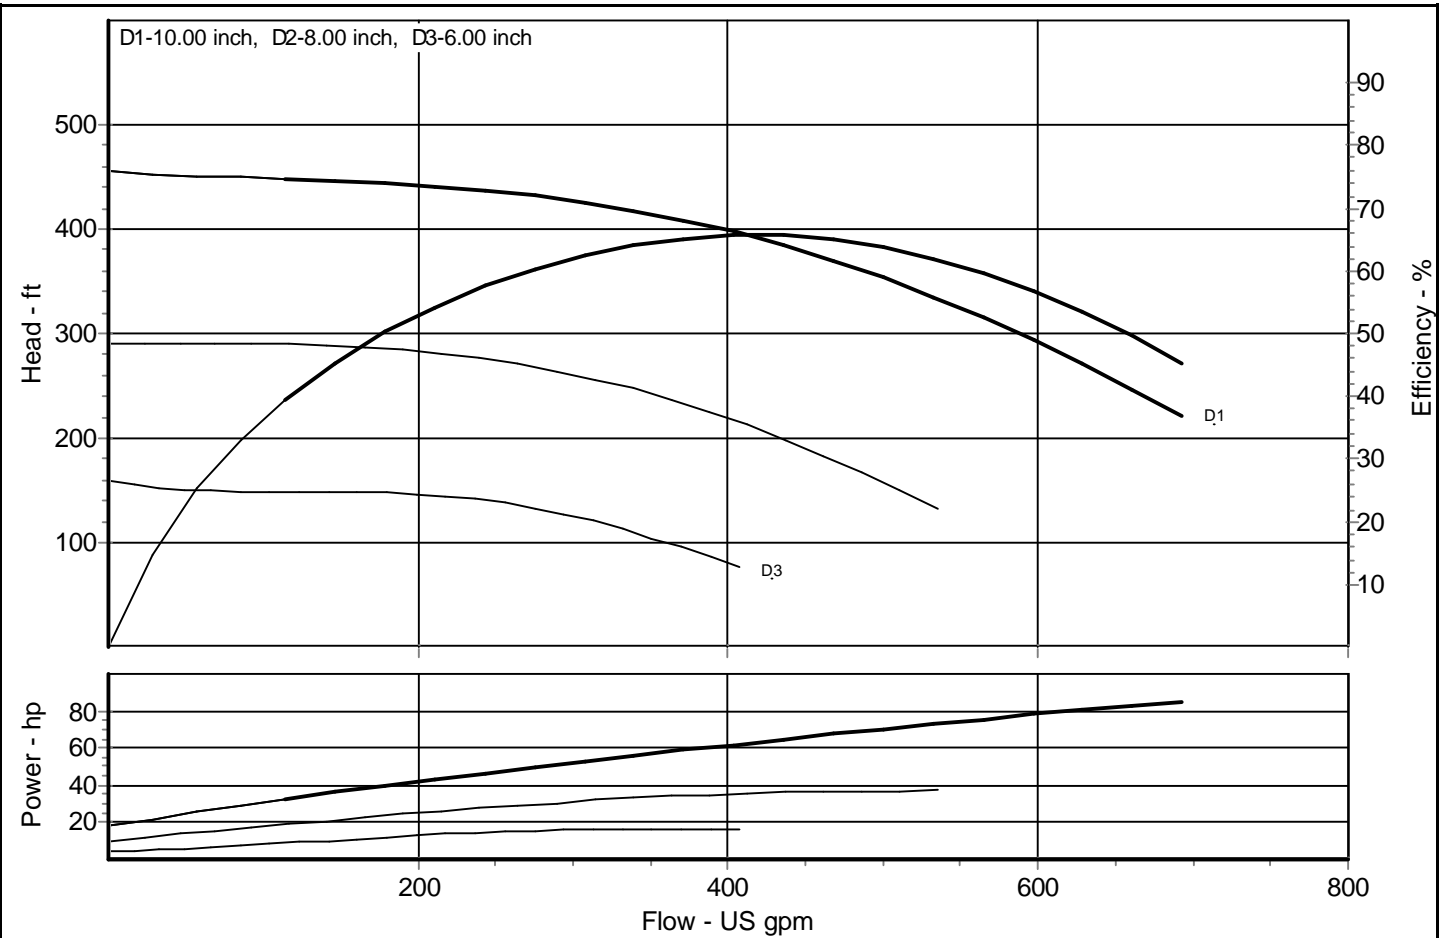

Comments:

Performance curve represents typical performance. See Standard Hydraulic Performance document in the selective printing area of RAPID for testing tolerances & contractual guarantees.

