




Peerless Pump Company
 Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 10HXB-1760 Rpm

Horsepower for _____ Stages

SECTION 140
 Page 1760-29
 October, 1974

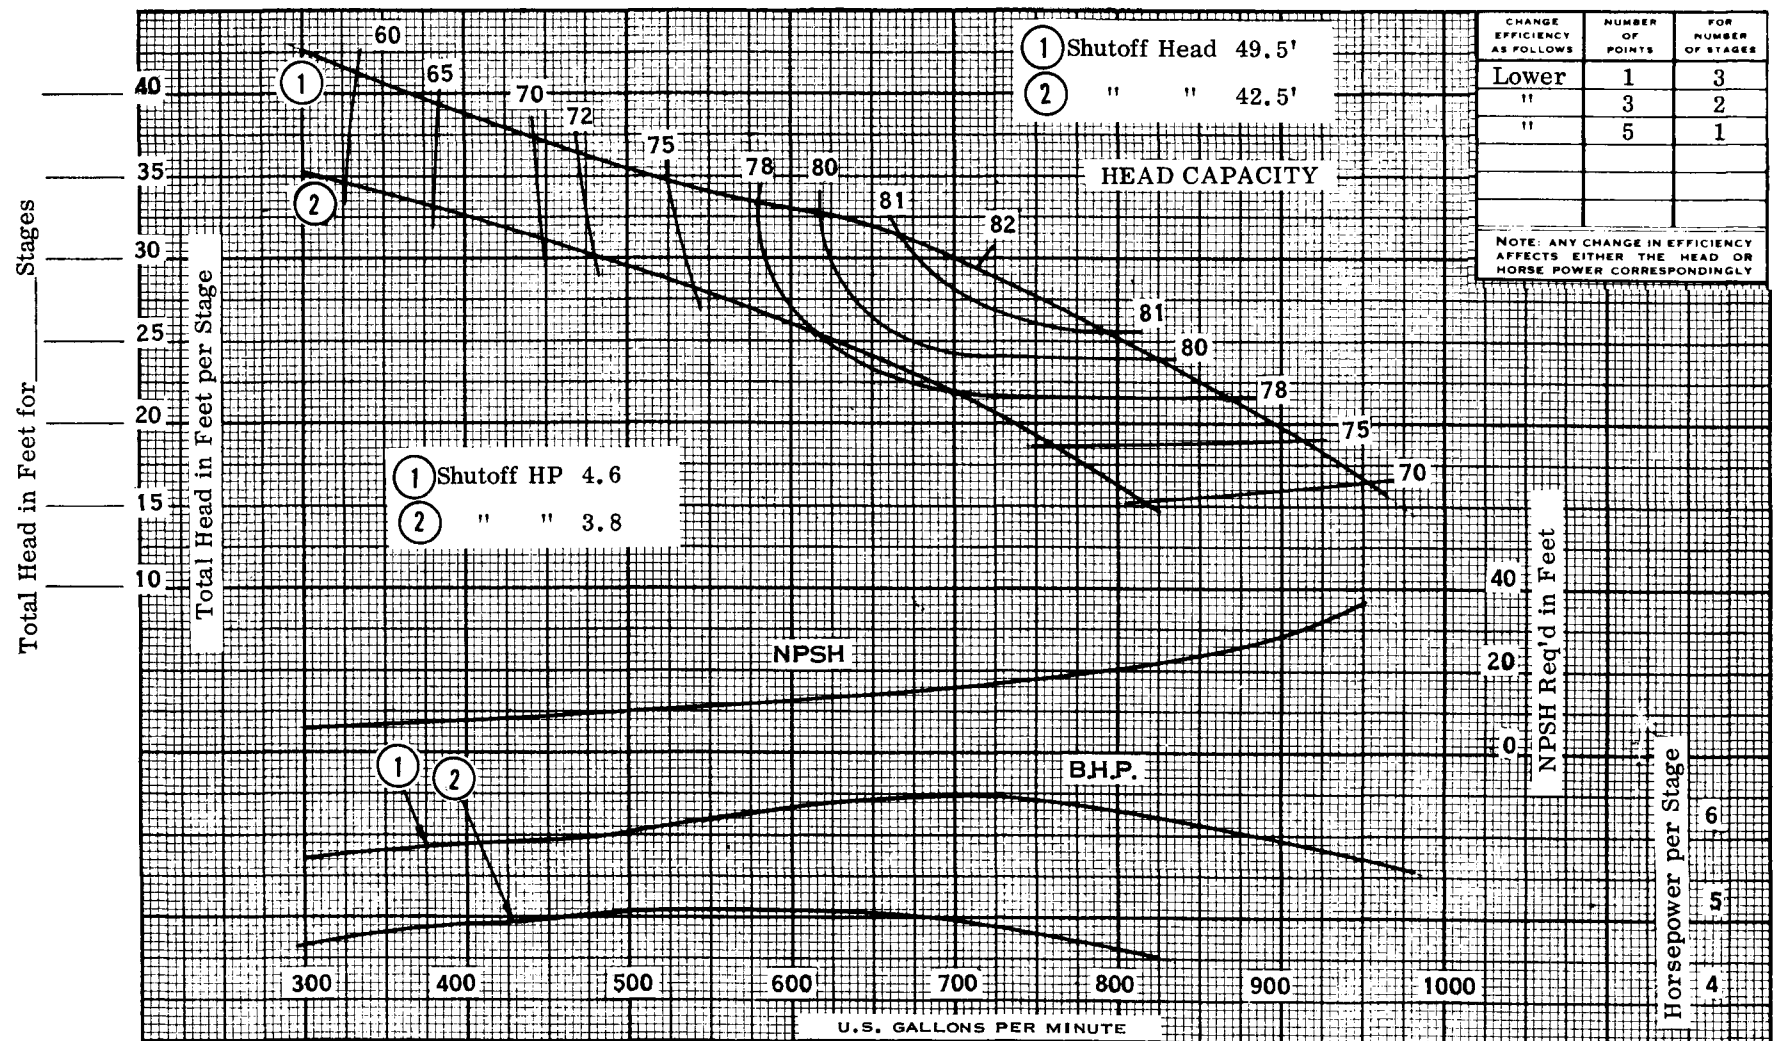

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer
	1	T82337	6 ¹ / ₄ " x 7 ¹ / ₈ "	27195	
Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	2	T82337	5 ¹⁵ / ₁₆ " x 6 ¹³ / ₁₆ "	27309	Item _____
	3				Peerless Ref. No: _____
	4				

Laboratory Performance		BOWL	T82474-E
SIZE	10 HXB	RPM	1760
		CURVE	2811625

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



Peerless Pump Company
Indianapolis, IN 46207-7025


VERTICAL TURBINE PUMPS
Model 10HXB-1760 Rpm

Horsepower for _____ Stages

SECTION 140
Page 1760-31
October, 1974

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
Lower	1	3
"	3	2
"	5	1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSE POWER CORRESPONDINGLY

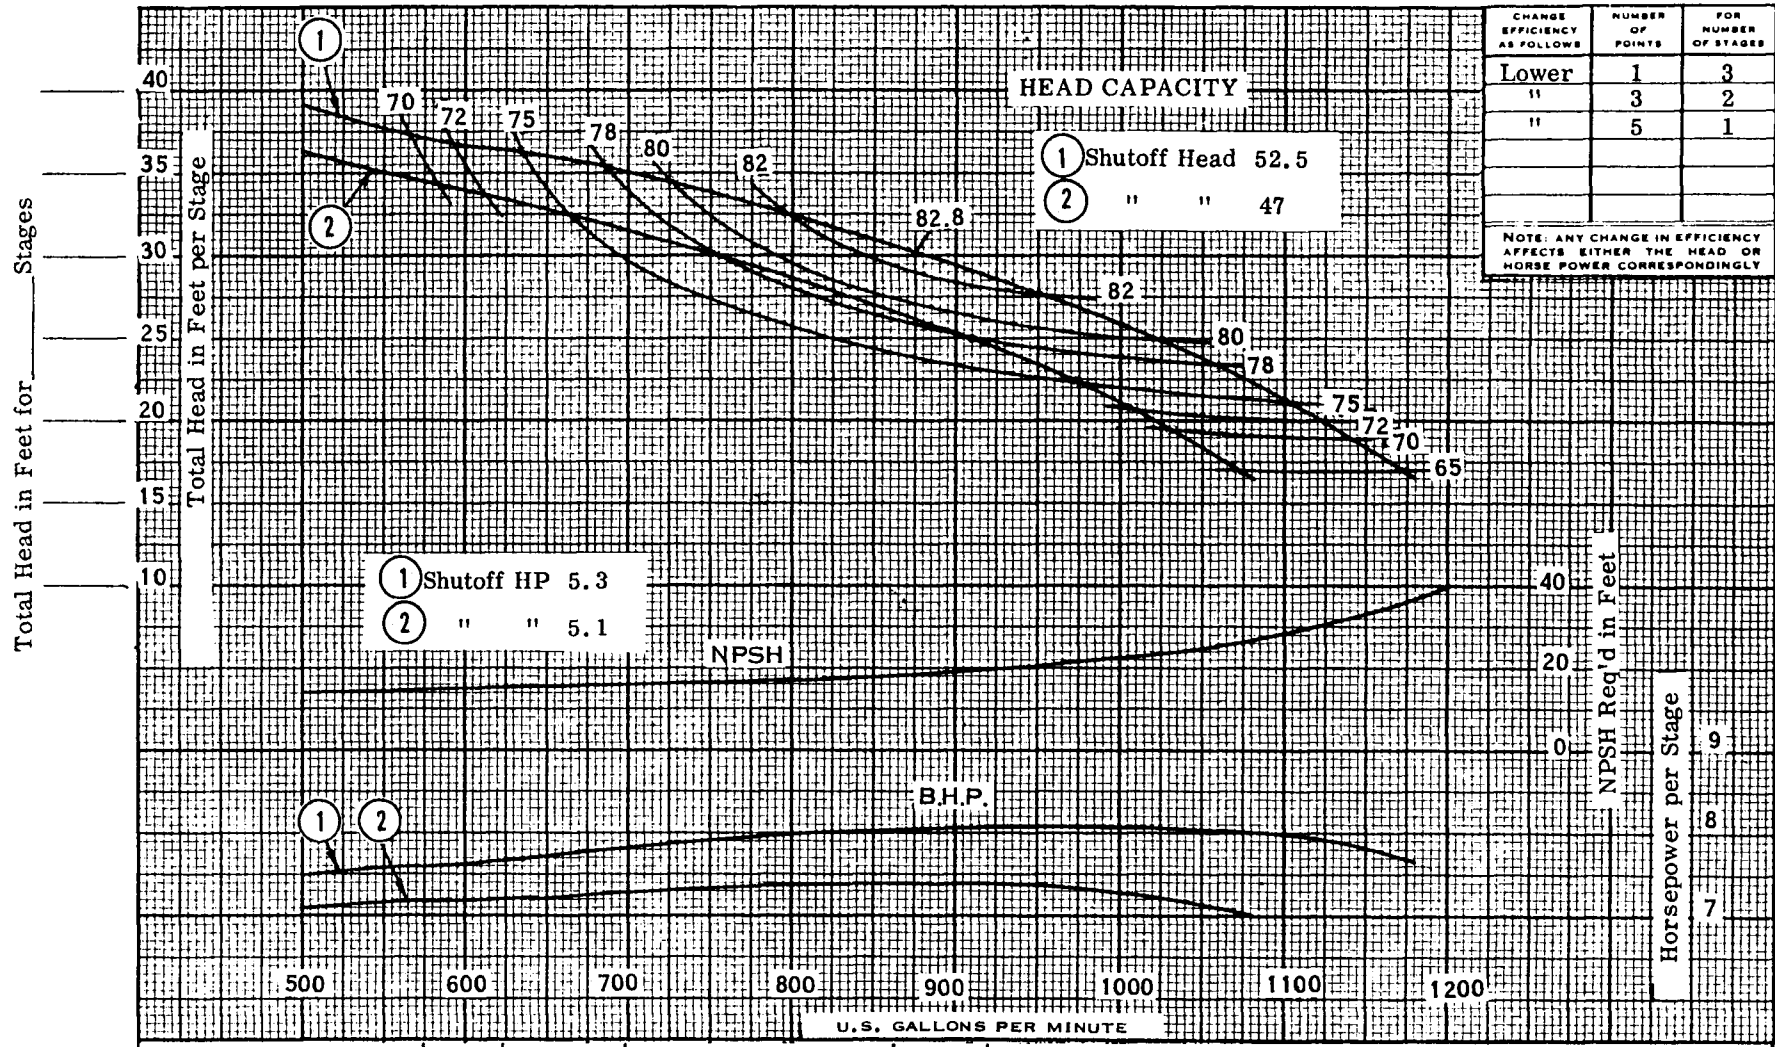

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	T82366	6 ⁷ / ₁₆ " x 7 ³ / ₈ "	27204	Item _____
	2	T82366	6 ¹ / ₈ " x 7 ¹ / ₁₆ "	27303	Peerless Ref. No: _____
	3				Laboratory Performance
	4				SIZE 10 HXB RPM 1760 CURVE 2811598

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL FIELD PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____



Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS


Stages _____
Horsepower for _____

Section 140
10-74

Lower	1	3
"	3	2
"	5	1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSE POWER CORRESPONDINGLY.

Total Head in Feet for _____ Stages

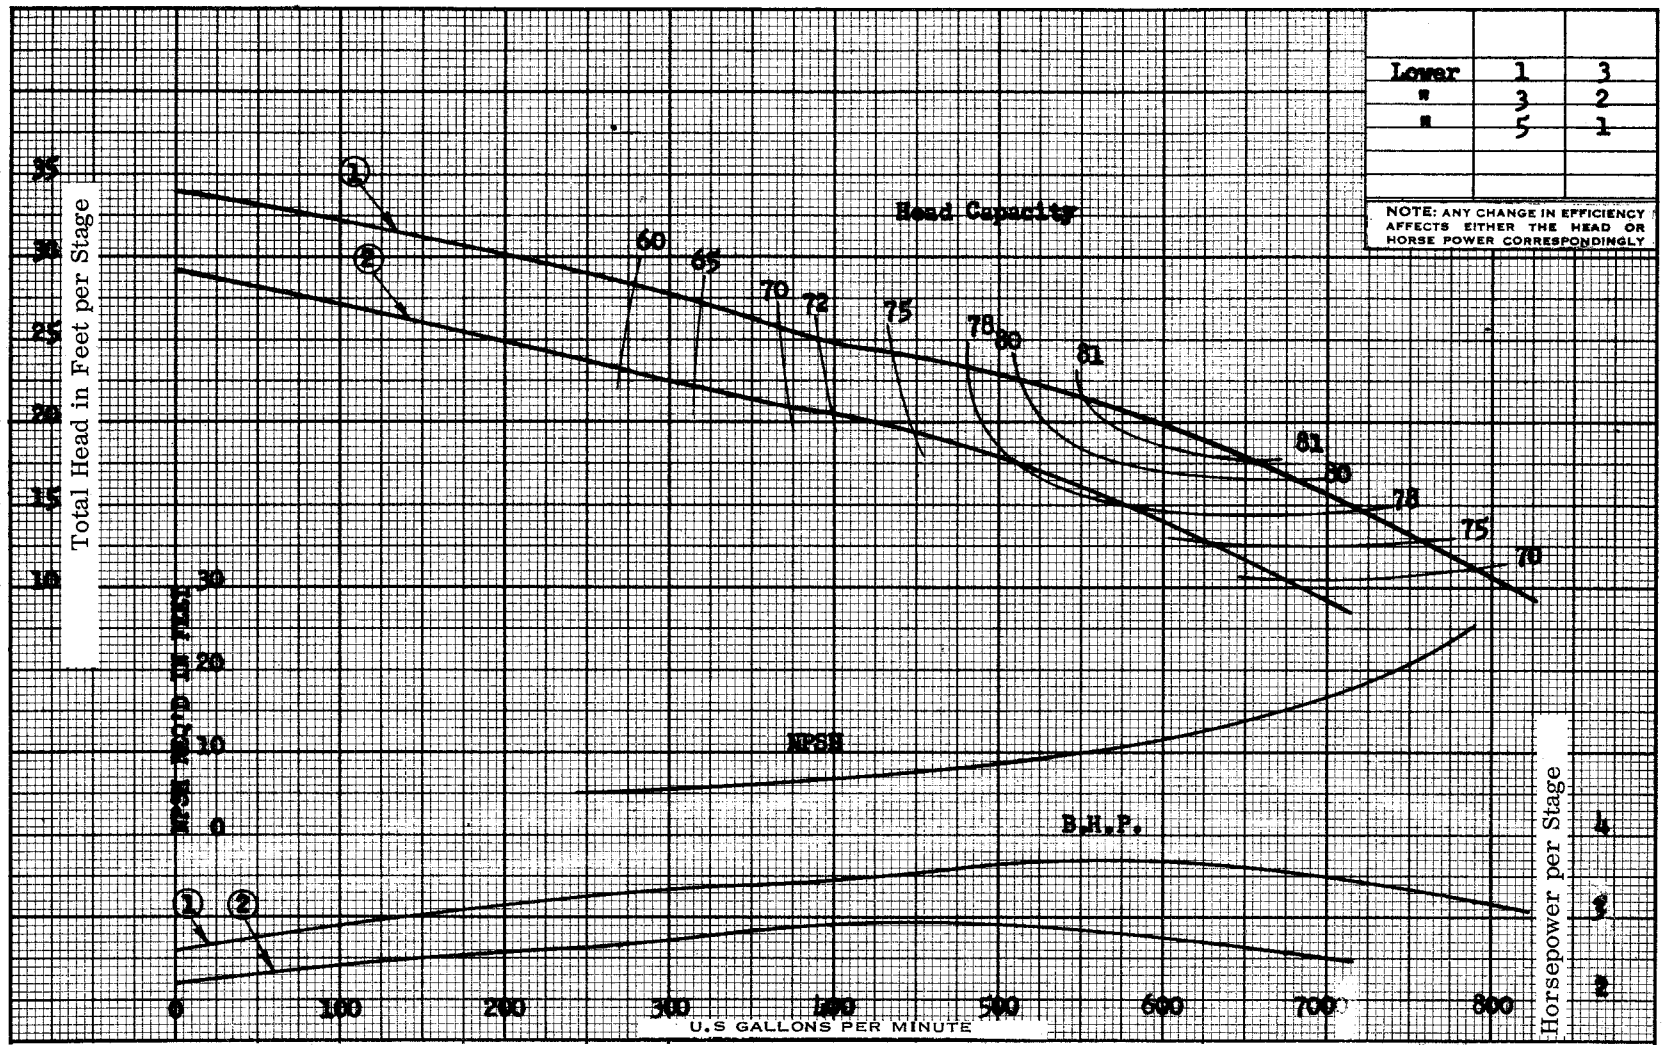

140-50Hz Page 41

HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO. 1	IMPELLER NO. T-82337	IMPELLER DIA. 6 1/4" x 7 1/8"	TAKEN FROM	Customer _____											
	2	T-82337	5 15/16" x 6 13/16"		Item _____											
	3				Peerless Ref. No: _____											
	4				<table border="1"> <tr> <td colspan="2">Laboratory Performance</td> <td>BOWL</td> <td>T-82474-E</td> </tr> <tr> <td>SIZE</td> <td>10 HXB</td> <td>RPM</td> <td>1460</td> </tr> <tr> <td></td> <td></td> <td>CURVE</td> <td>28 12363</td> </tr> </table>	Laboratory Performance		BOWL	T-82474-E	SIZE	10 HXB	RPM	1460			CURVE
Laboratory Performance		BOWL	T-82474-E													
SIZE	10 HXB	RPM	1460													
		CURVE	28 12363													

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS

Stages _____ for _____ Horsepower

Section 140
10-74

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
Lower	1	3
"	3	2
"	1	1

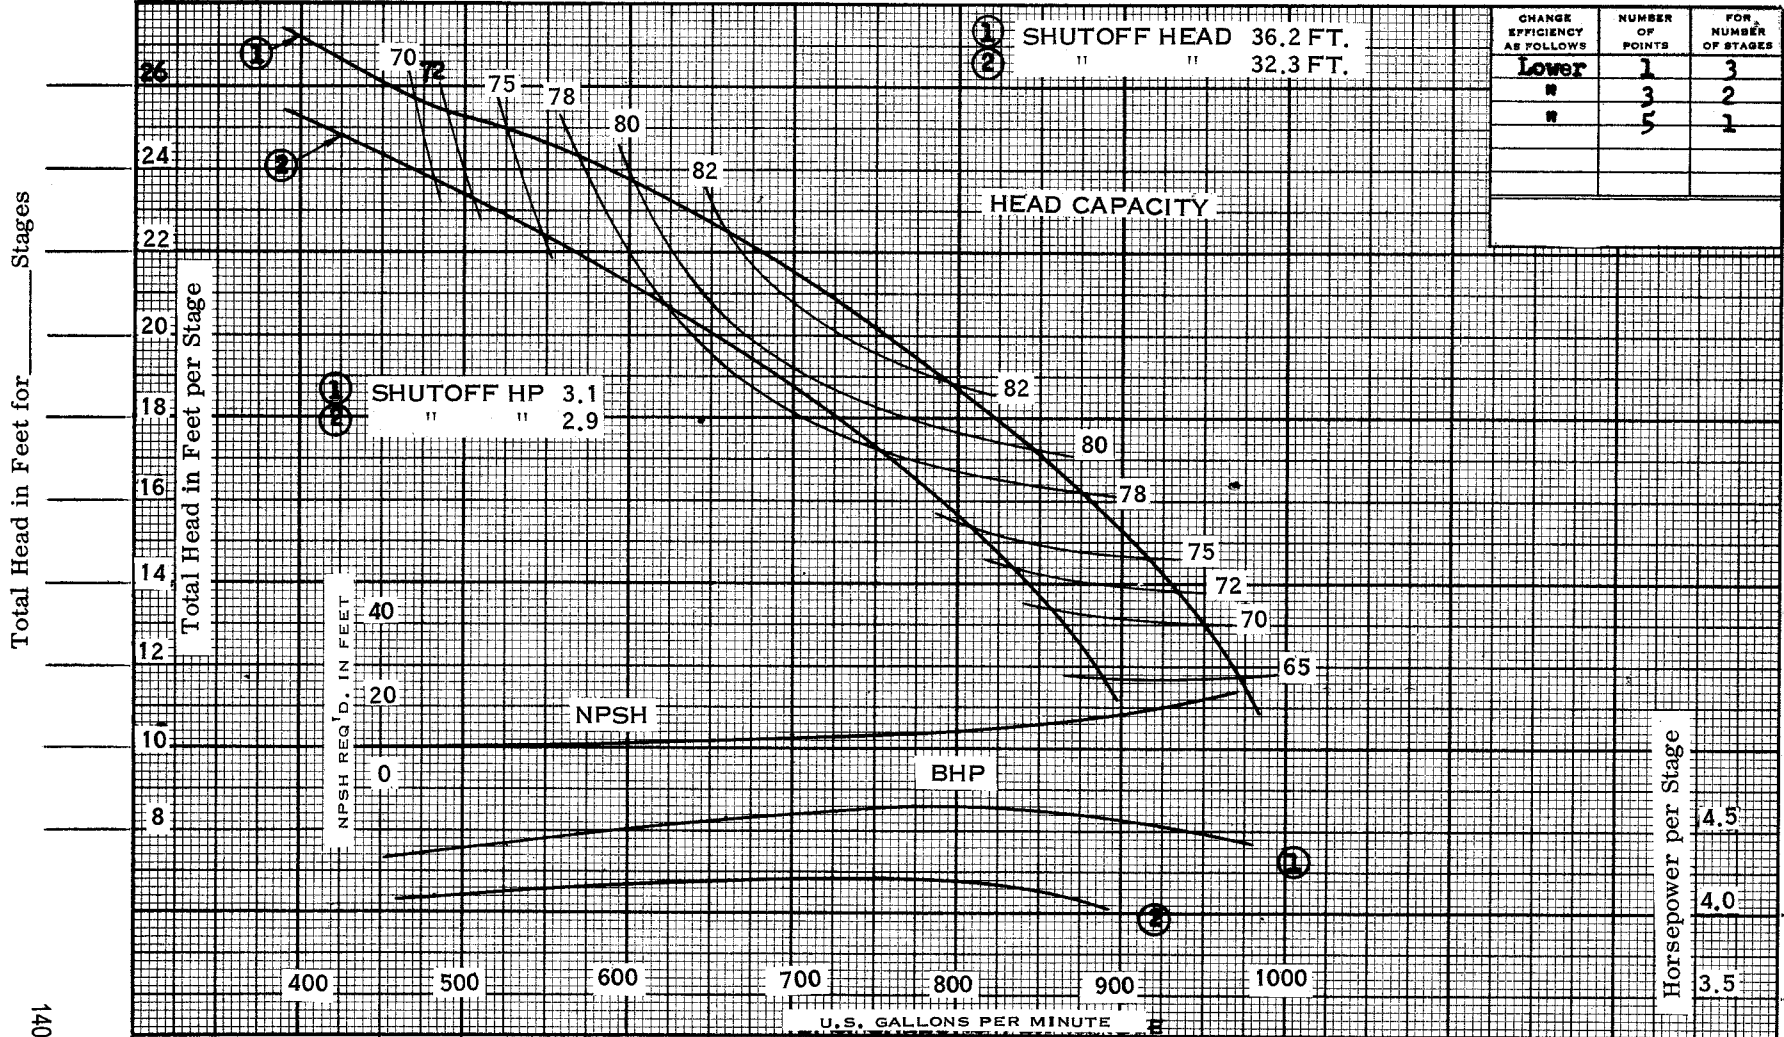

Total Head in Feet for _____ Stages

Total Head in Feet per Stage

NPSH REQ'D. IN FEET

Horsepower per Stage

U.S. GALLONS PER MINUTE

HYDRAULIC PERFORMANCE	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
at designated point	1	T-82366	6 ⁷ / ₁₆ x 7 ³ / ₈	27204	_____
Efficiency must be reduced for bronze & special material bowls - See Application Section	2	T-82366	6 ¹ / ₈ x 7 ¹ / ₁₆	27303	Item _____
	3				Peerless Ref. No: _____
	4				

Laboratory Performance		BOWL	T-82474-E
SIZE	10 HXB	RPM	1460
		CURVE	2812384

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL FIELD PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____