


VERTICAL TURBINE PUMPS
Model 14MD - 1770 Rpm



Peerless Pump Company
Indianapolis, IN 46207-7026

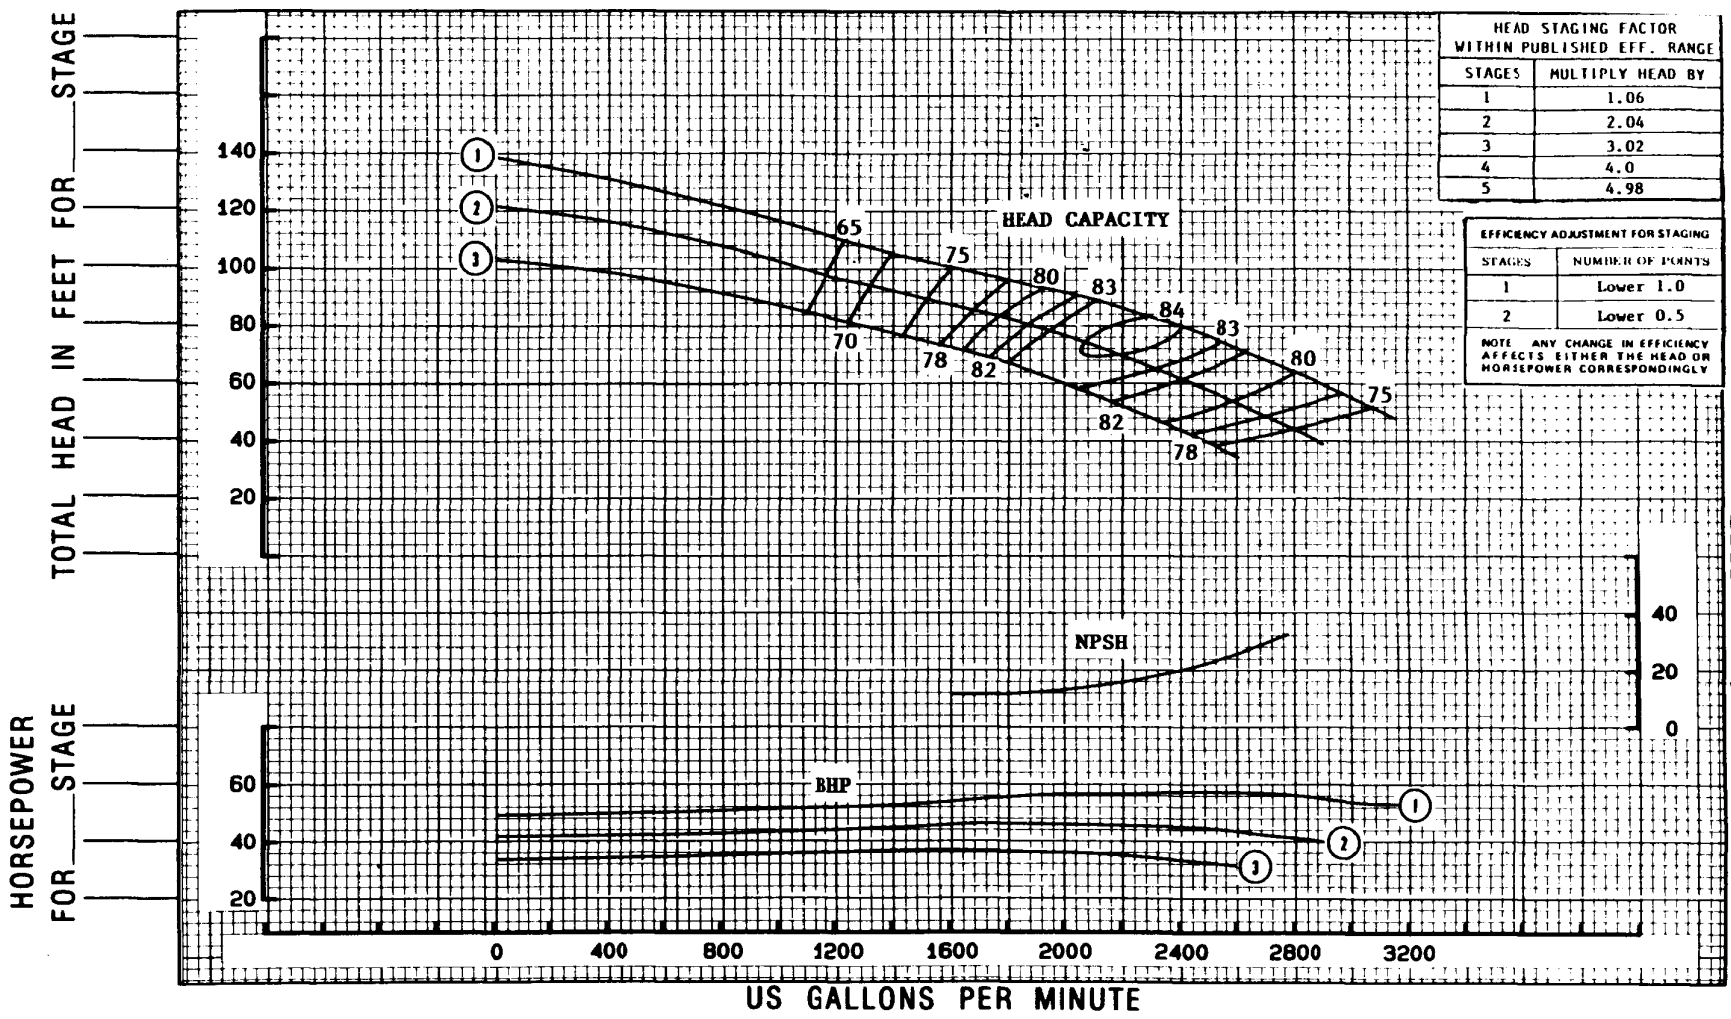

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602279	9.75 x 11.62	63743	Item _____
	2	4602279	9.41 x 11.25	63876	Peerless Ref. No: _____
	3	4602279	8.81 x 10.62	63923	Laboratory Performance
4					SIZE 14MD RPM 1770 BOWL 4602248 CIE CURVE 4806409

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 14MD - 1770 Rpm

IEEE NI HSDN

SECTION 140
Page 1760-59
September, 1991

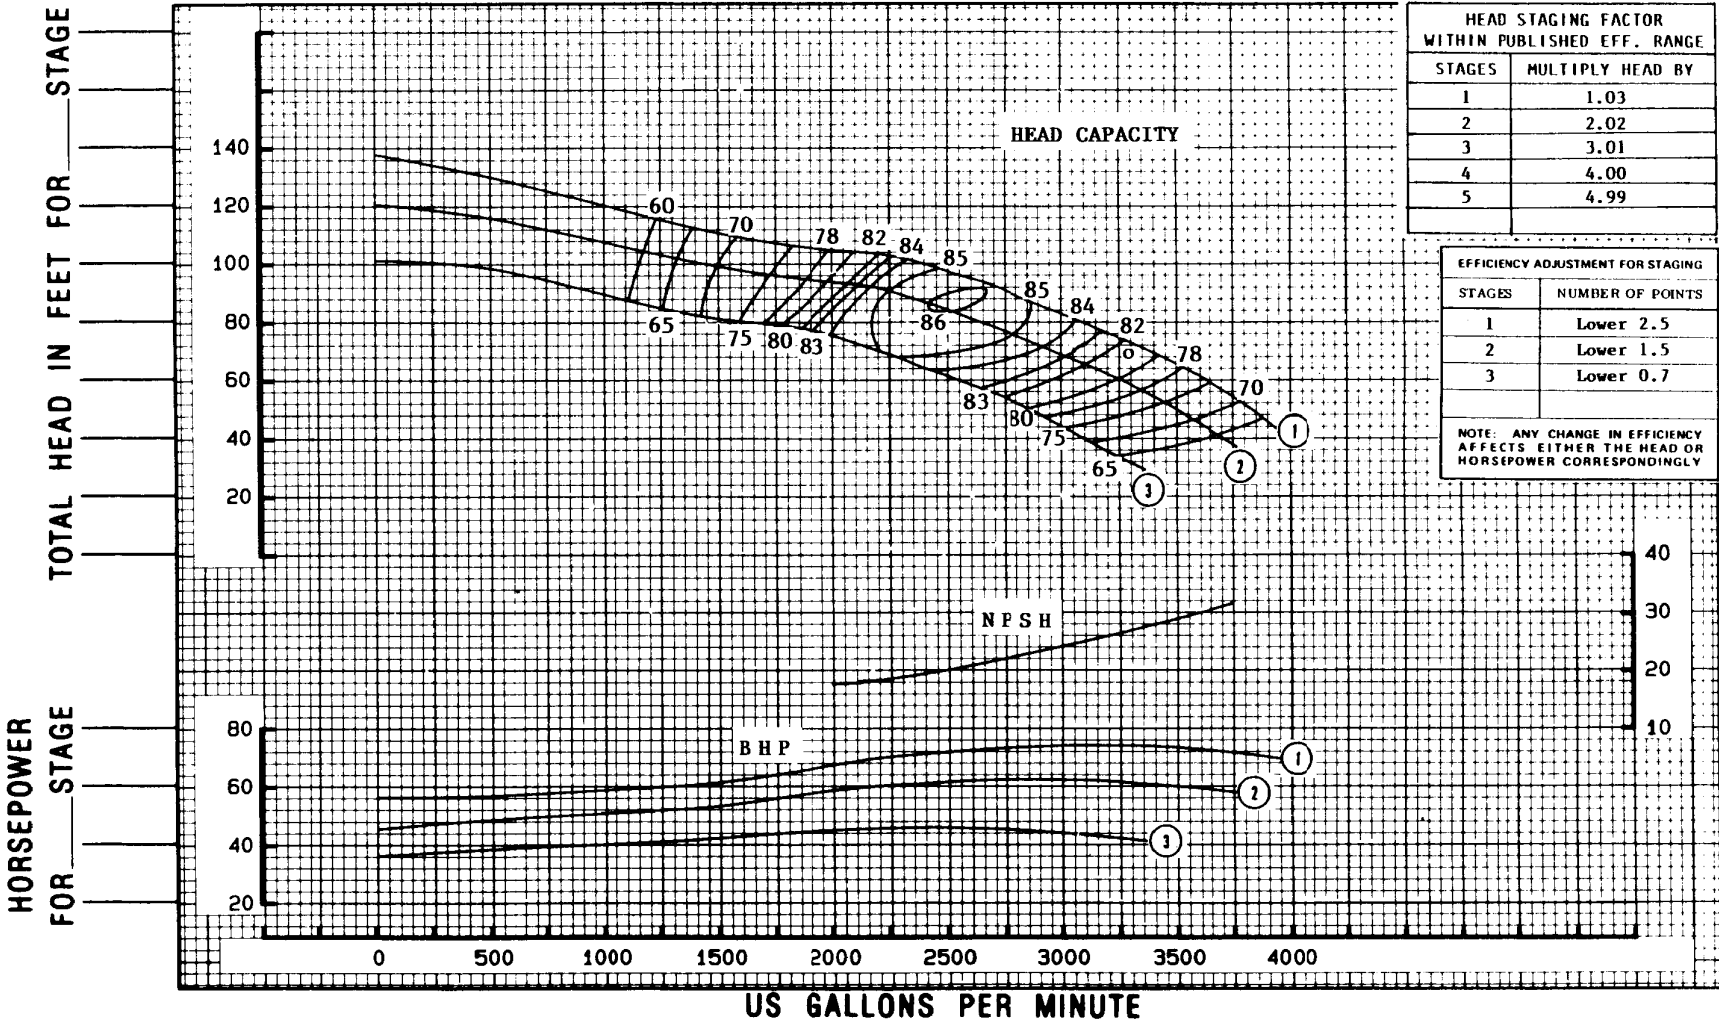

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602280	9.75 x 11.62	64830	Item _____
	2	4602280	9.41 x 11.25	64939	Peerless Ref. No: _____
	3	4602280	8.81 x 10.62	64976	Laboratory Performance
	4				SIZE 14MD RPM 1770 BOWL 4602248 CIE
					CURVE 4806414


PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 14MD - 1180 Rpm

SECTION 140
Page 1160-29
September, 1991

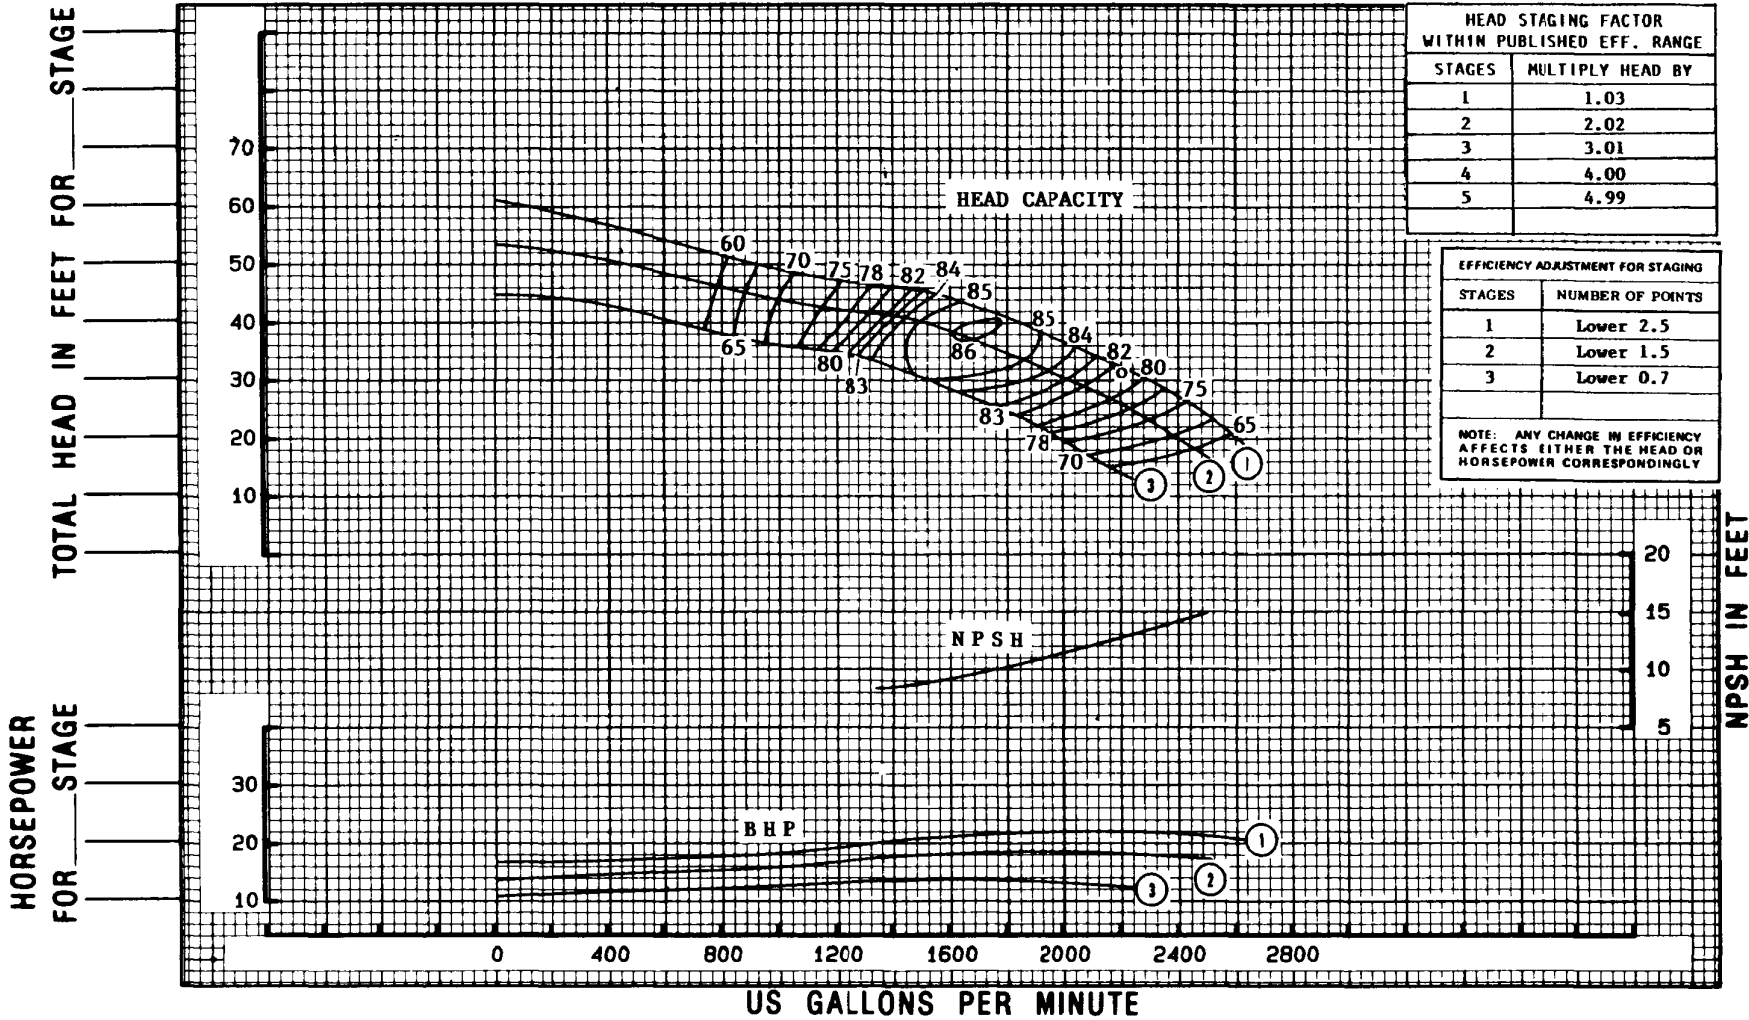

Head and Capacity Warranty Contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602280	9.75 x 11.62	64830	Item _____
	2	4602280	9.41 x 11.25	64939	Peerless Ref. No. _____
	3	4602280	8.81 x 10.62	64976	Laboratory Performance
	4				SIZE 14MD RPM 1180 CURVE 4806415


PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



HEAD STAGING FACTOR WITHIN PUBLISHED EFF. RANGE	
STAGES	MULTIPLY HEAD BY
1	1.06
2	2.04
3	3.02
4	4.0
5	4.98

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 1.0
2	Lower 0.5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

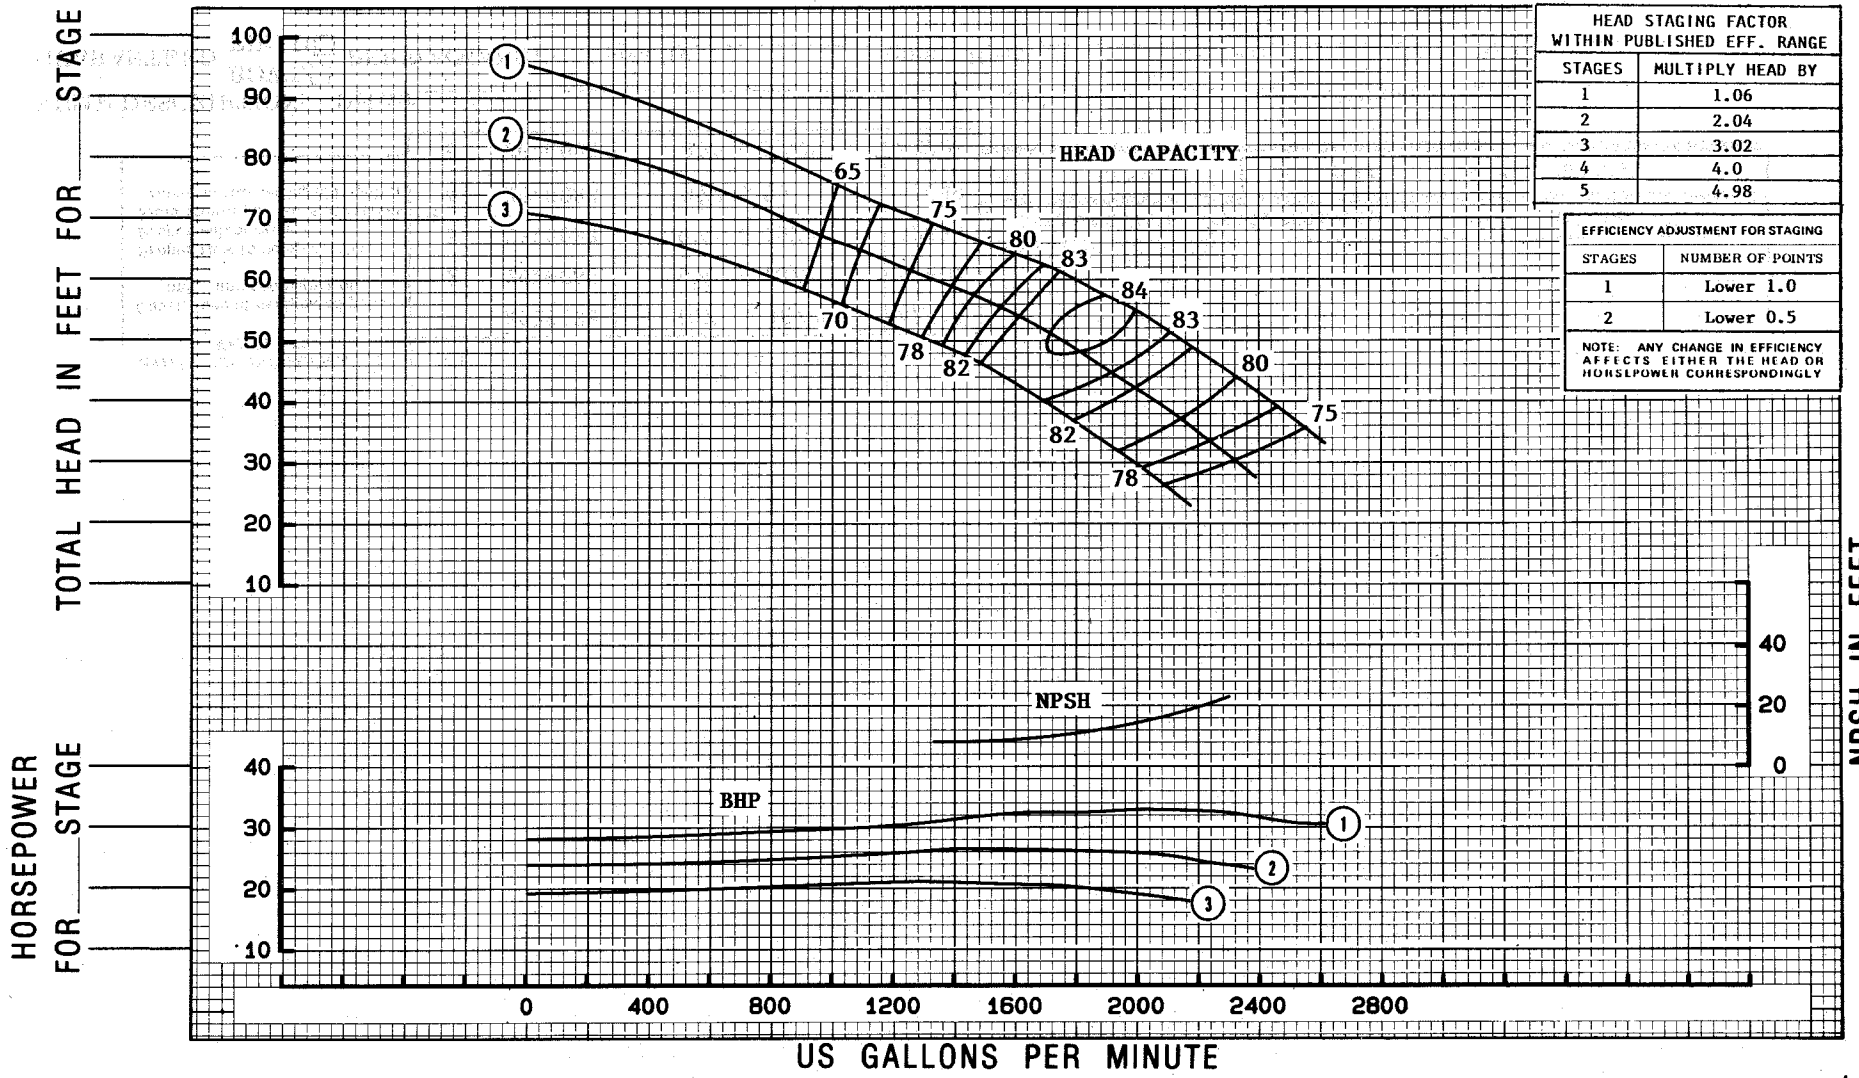

FEET IN HSPN

HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602279	9.75 x 11.62	63743	Item _____
	2	4602279	9.41 x 11.25	63876	Peerless Ref. No: _____
	3	4602279	8.81 x 10.62	63923	
	4				Laboratory Performance SIZE 14MD RPM 1470 BOWL 4602248 CIE CURVE 4806411

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD

