




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
Model 24HXC - 1180 Rpm

133F NI HSNB

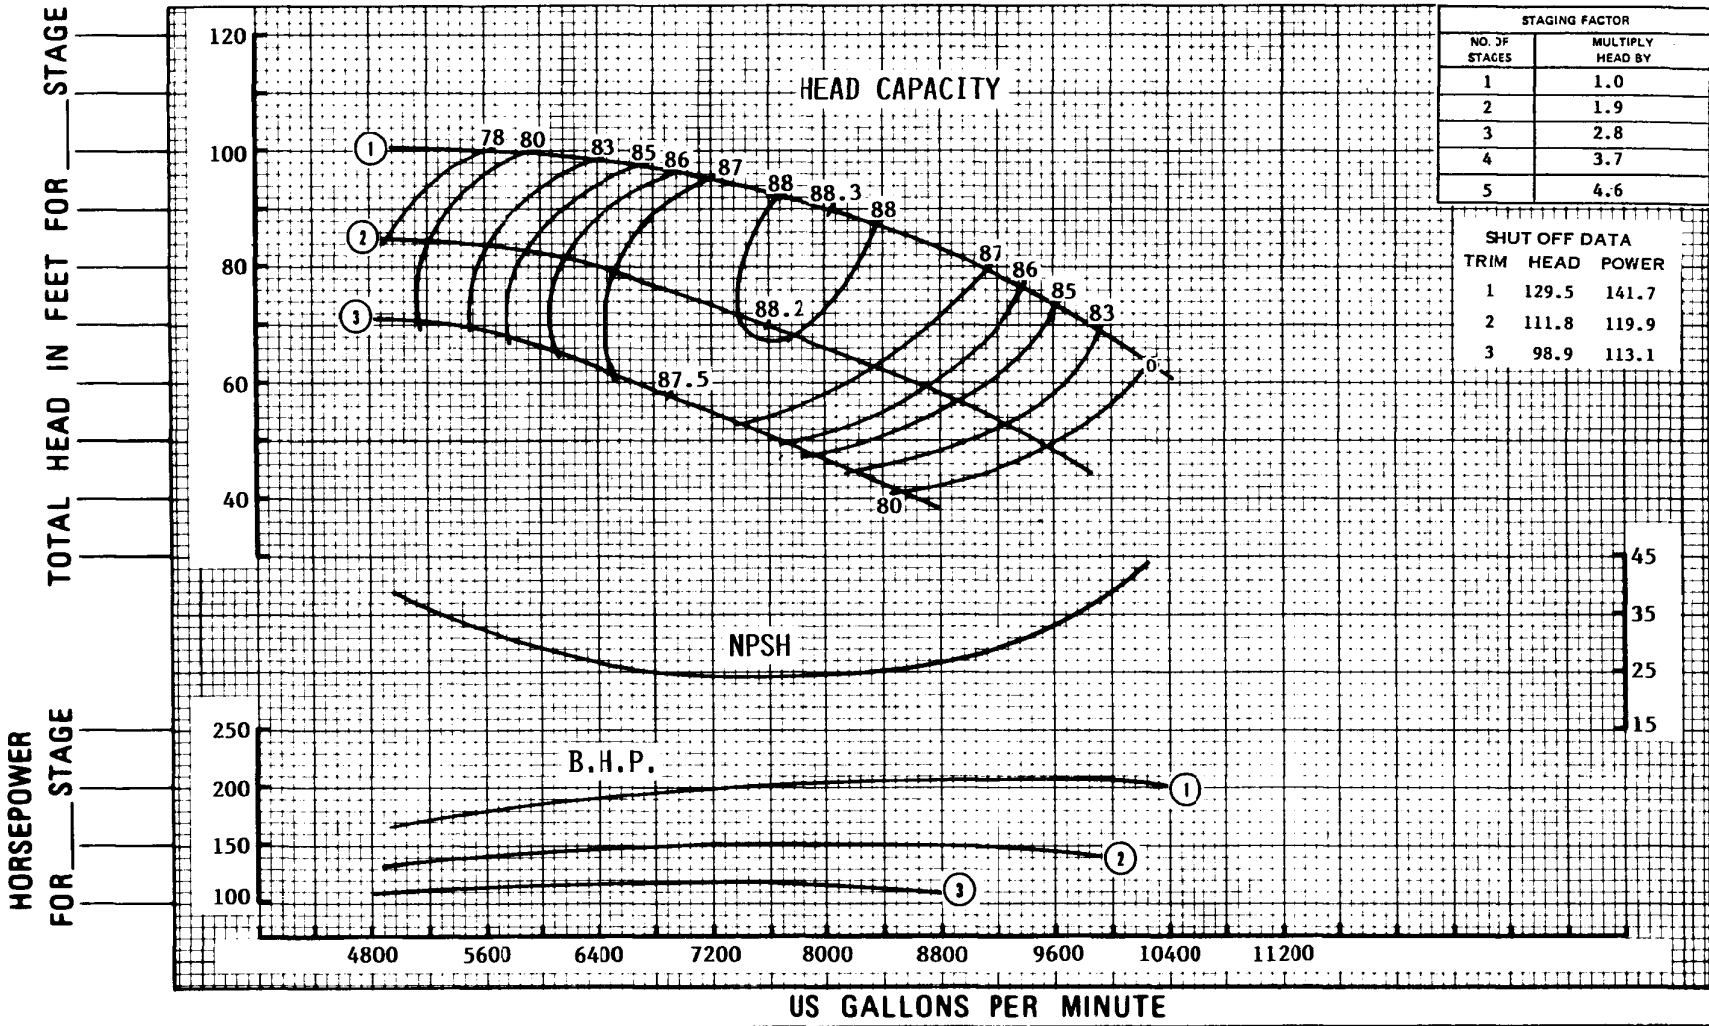

Head and Capacity Warranty Contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____						
	1	4602026	14.92 x 17.19	62807	Item _____						
	2	4602026	14 x 16.25	62987	Peerless Ref. No: _____						
	3	4602026	12.75 x 15.56	63164	Laboratory Performance						
	4				<table border="1"> <tr> <td>SIZE 24HXC</td> <td>RPM 1180</td> <td>BOWL 4602253 Plastic Coated</td> </tr> <tr> <td></td> <td></td> <td>CURVE 4806402</td> </tr> </table>	SIZE 24HXC	RPM 1180	BOWL 4602253 Plastic Coated			CURVE 4806402
SIZE 24HXC	RPM 1180	BOWL 4602253 Plastic Coated									
		CURVE 4806402									

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
) BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
) FIELD


SECTION 140
Page 1160-69
June, 1990



Peerless Pump Company
 Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS
 Model 24HXC - 885 Rpm

SECTION 140
 Page 870-9
 June, 1990

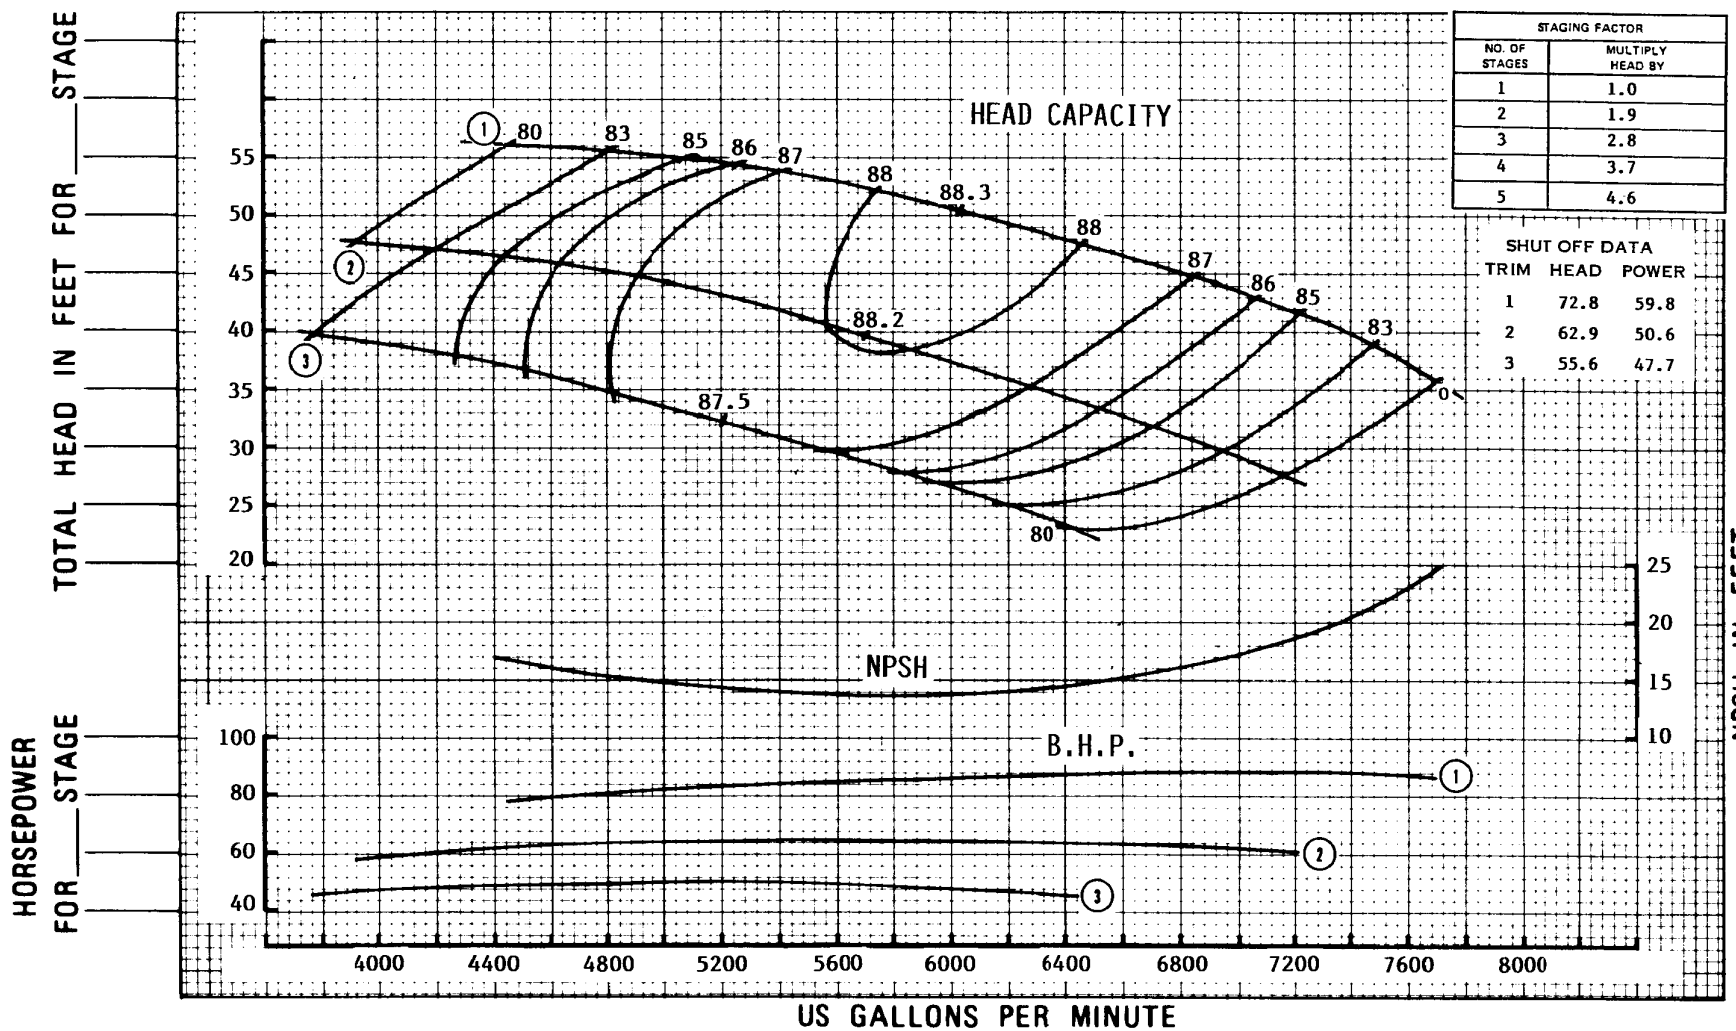

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602026	14.92 x 17.91	62807	Item: _____
	2	4602026	14 x 16.25	62987	Peerless Ref. No: _____
	3	4602026	12.75 x 15.56	63164	Laboratory Performance
4					SIZE 24HXC RPM 885 CURVE 4806400


PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 GUARANTEED BOWL PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD



Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS

Section 140
6-90

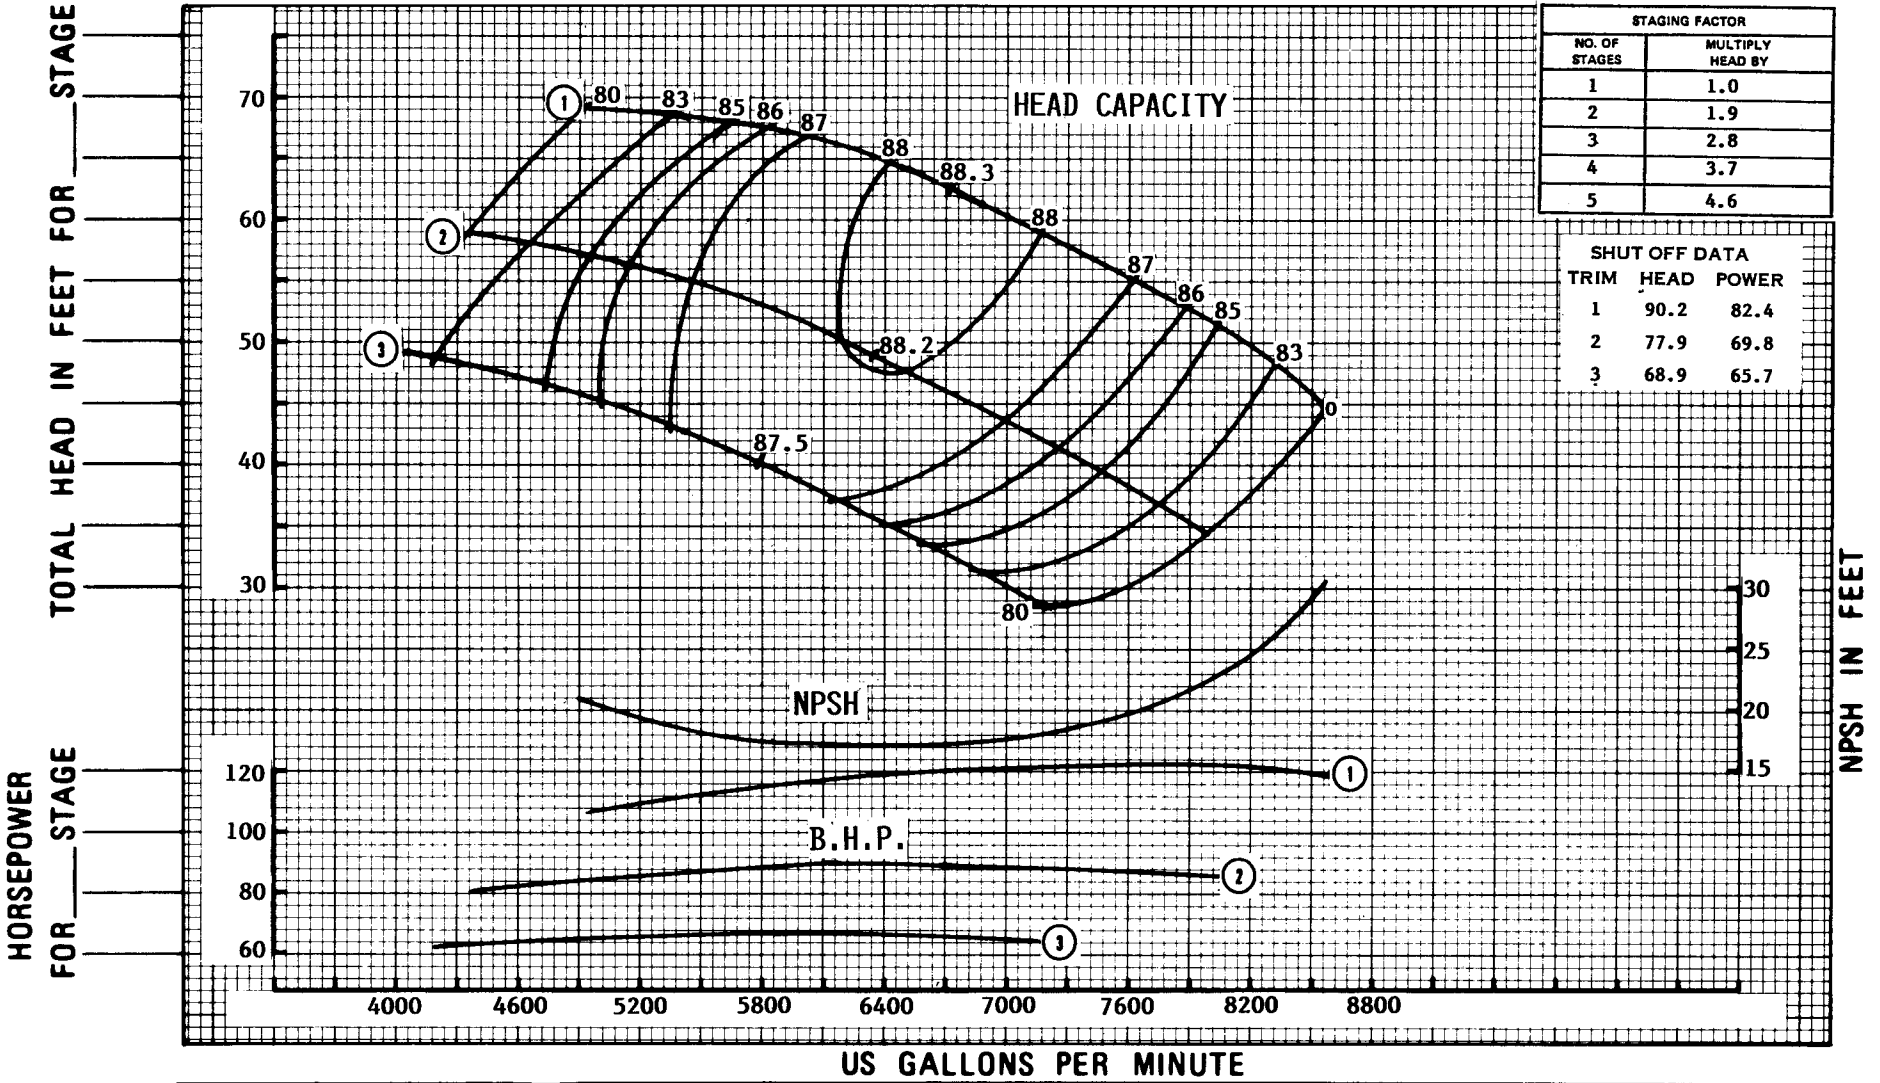

HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	1	4602026	14.92 x 17.19	62807	Customer _____
	2	4602026	14 x 16.25	62987	Item _____
	3	4602026	12.75 x 15.56	63164	Peerless Ref. No: _____
	4				
					Laboratory Performance BOWL 4602253 Plastic Coated SIZE 24HXC RPM 985 CURVE 4806401

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL FIELD PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____




Peerless Pump Company
Indianapolis, IN 46207-7025

VERTICAL TURBINE PUMPS

Section 140
6-90

STAGE _____
 TOTAL HEAD IN FEET FOR _____ STAGE
 HORSEPOWER FOR _____ STAGE

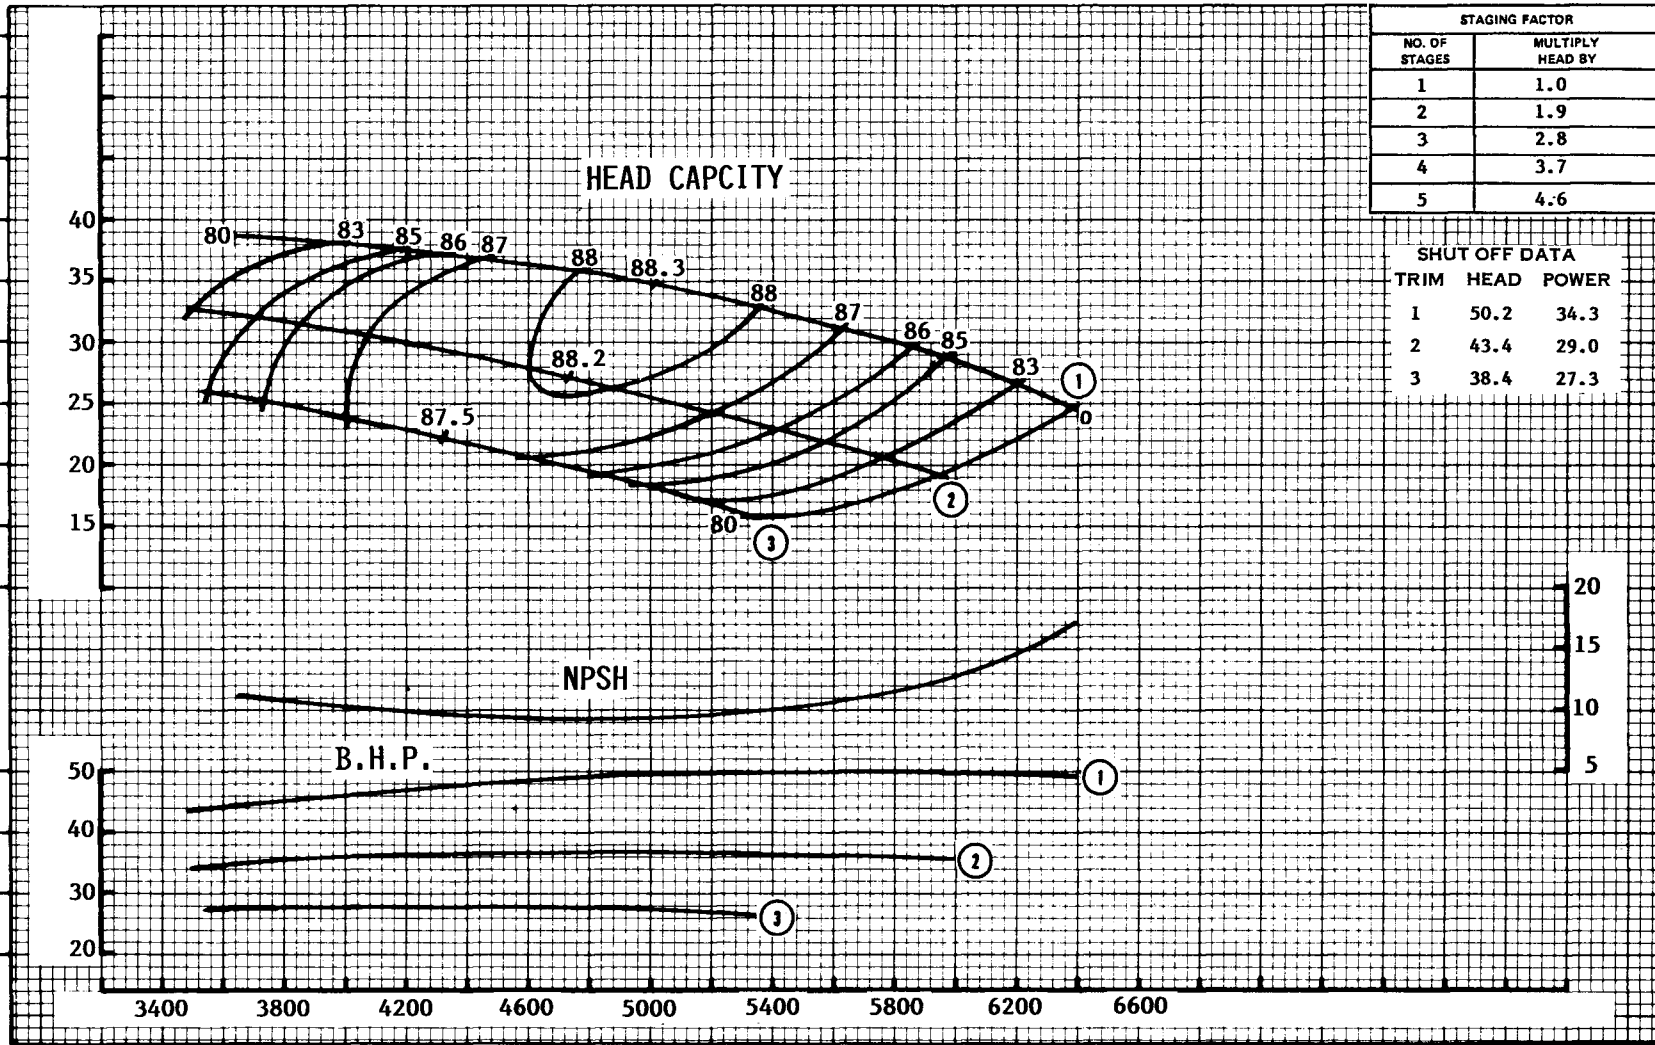

NPSH IN FEET

HYDRAULIC PERFORMANCE WARRANTY at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	4602026	14.92 x 17.19	62807	Item _____
	2	4602026	14 x 16.25	62987	Peerless Ref. No: _____
	3	4602026	12.75 x 15.56	63164	Laboratory Performance
4					BOWL 4602253 Plastic Coated SIZE 24HXC RPM 735 CURVE 4806399

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL FIELD PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____